

Exhibit A

Recommended Amendments to the 2018 International Building Code City of Amarillo, Texas

The following sections, paragraphs, and sentences of the 2018 International Building Code are hereby amended as follows: Standard type is text from the IBC. Underlined type is text inserted. ~~Lined through type is deleted text from IBC.~~ A double asterisk (**) at the beginning of a section identifies an amendment carried over from the 2015 edition of the code and a triple asterisk (***) identifies a new or revised amendment with the 2018 code.

****Section 101.1; change to read as follows:**

101.1 Title. These regulations shall be known as the Building Code of the City of Amarillo, hereinafter referred to as "this code."

(Reason: Standard insertion point: [insert] to assist with local adoption.)

****Section 101.4; change to read as follows:**

101.4 Referenced codes. The other codes listed in Sections 101.4.1 through 101.4.8 and referenced elsewhere in this code, when specifically adopted, shall be considered part of the requirements of this code to the prescribed extent of each such reference. Whenever amendments have been adopted to the referenced codes and standards, each reference to said code and standard shall be considered to reference the amendments as well. Any reference to NFPA 70 or the Electrical Code shall mean the Electrical Code as adopted.

(Reason: Legal wording to recognize locally adopted codes and amendments adopted with referenced codes. The former ICC Electrical Code is now Appendix K of this code but no longer called by that name.)

*****Section 101.4.8; add the following:**

101.4.8 Electrical. The provisions of the Electrical Code shall apply to the installation of electrical systems, including alterations, repairs, replacement, equipment, appliances, fixtures, fittings and appurtenances thereto.

(Reason: This was dropped when ICC quit publishing the ICC Electrical Code, but the Electrical Code still should be referenced regardless of how it is adopted.)

**** Section 103 and 103.1; amend to insert the Department Name**

DEPARTMENT OF BUILDING SAFETY

103.1 Creation of enforcement agency. The City of Amarillo Department of Building Safety is hereby created and the official in charge thereof shall be known as the **Chief** Building Official.

(Reason: Reminder to be sure ordinance reads the same as designated by the city.)

*****Section [A] 104.2.1 Determination of substantially improved or substantially damaged existing buildings and structures in flood hazard areas; Delete entire section.**

(Reason: Flood hazard ordinances is administered by other departments within the city.)

*****Section 104.10.1; Flood hazard areas; Delete entire section.**

(Reason: Flood hazard ordinances is administered by other departments within the city.)

****Section 105.2 Work exempt from permit; under sub-title entitled "Building" delete items 1, 2, 10 and 11 and re-number as follows:**

Building:

1. ~~{Remainder of text unchanged}~~ One-story detached accessory structures used as tool and storage sheds, playhouses and similar uses, provided the floor area is not greater than ~~420 square feet (11 m²).~~ 200 square feet (18.58m²).
2. ~~{Remainder of text unchanged}~~ Fences not over ~~7 feet (2134 mm)~~ 8 feet (2440 mm) high.
3. {Remainder of text unchanged}
4. {Remainder of text unchanged}
5. {Remainder of text unchanged}
6. {Remainder of text unchanged}
7. {Remainder of text unchanged}
8. {Remainder of text unchanged}
9. {Remainder of text unchanged}
10. ~~Shade cloth structures constructed for nursery or agricultural purposes, not including service systems. {Remainder of text unchanged}~~
11. {Remainder of text unchanged}
12. {Remainder of text unchanged}
13. {Remainder of text unchanged}
14. Replacement glass and glazing in commercial buildings when replacement occurs in existing sash or frame.

(Reason: Items deleted are for one- and two-family dwellings regulated by the International Residential Code. Shade cloth structures would require a permit for commercial properties to ensure compliance with local ordinance, egress, accessibility, flame spread of fabric, wind/snow design load, etc.)

****Section 107.1; change to read as follows:**

107.1 General. Submittal documents consisting of construction documents, statement of special inspections, geotechnical report and other data shall be submitted in two or more sets with each permit application. The construction documents shall be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed, and shall contain the seal of a Texas-licensed engineer or Texas-licensed architect where the following conditions exist:

1. For new construction, additions, expansions or for changes in occupancy of:
 - a. All occupancies of 5,000 square feet or more in area; or
 - b. Buildings and structures more than two stories above grade plane.
2. For alterations, repair or rehabilitation of:
 - a. All occupancies where the affected area exceeds 5,000 square feet or the proposed work involves or affects structural elements, fire-resistive elements or means of egress.

The registered design professional who prepares construction documents shall have full responsibility for complying with Texas Occupations Code, Chapter 1001 (Engineers) or Chapter 1051 (Architects), as applicable, and shall affix design professional official seal to said drawings, specifications and accompanying data. Where special conditions exist, the building official is authorized to require additional construction documents to be prepared by a registered design professional.

Exception: The Building Official is authorized to waive the submission of construction documents and other data not required to be prepared by a registered design professional if it is found that the nature of the work applied for is such that review of the construction documents is not necessary to obtain compliance with this code.

(Reason: Commercial structures over 5000SF present special life safety concerns best addressed by a licensed design professional.)

****109.3; change to read as follows:**

109.3 Building permit valuations. The applicant for a permit shall provide an estimated permit value at time of application. Permit valuations shall include total value of work, including materials and labor, for which the permit is being issued, such as electrical, gas, mechanical, plumbing equipment and permanent systems. If, in the opinion of the Building Official, the valuation is underestimated on the application, the permit shall be denied, unless the applicant can show detailed estimates to meet the approval of the building official. If the applicant fails to present sufficient documentation to support the valuation on the application, final building permit valuation shall be set by the Building Official in accordance with the most current Building Valuation Data as published by the International Code Council or approved statements sufficient to clearly document all construction costs.

(Reason: Past practice of assigning value, provides consistent standard for valuation of construction.)

*****Section 109; add Section 109.4.1 to read as follows:**

109.4.1 Work without a permit. Refer to City of Amarillo Ordinance No. 7188 and Chapter 4-1, Article I, Division I, Section 4-1-1 of the Amarillo Municipal Code.

(Reason: This fee is designed to compensate for time and to remove incentive to attempt to evade permits and code compliance.)

*****Section 109; add Section 109.7 to read as follows:**

109.7 Re-inspection Fee. A fee as established by city council resolution may be charged when:

1. The inspection called for is not ready when the inspector arrives;
2. No building address or permit card is clearly posted;
3. City approved plans are not on the job site available to the inspector;
4. The building is locked or work otherwise not available for inspection when called;
5. The job site receives a "Correction Required Notice." ~~tag twice for the same item;~~
6. ~~The original "Correction Required" tag has been removed from the job site.~~
7. 6. Failure to maintain erosion control, trash control or tree protection.

Any re-inspection fees assessed shall be paid before any more inspections are made on that job site.

(Reason: This fee is not a fine or penalty but is designed to compensate for time and trips when inspections are called for when not ready.)

~~Section 109; add Section 109.8, 109.8.1, 109.8.2 and 109.9 to read as follows: (See Section 109.4.1)~~**

109.8 Work without a permit:

~~**109.8.1 Investigation.** Whenever work for which a permit is required by this code has been commenced without first obtaining a permit, a special investigation shall be made before a permit may be issued for such work.~~

~~**109.8.2 Fee.** An investigation fee, in addition to the permit fee, shall be collected whether or not a permit is subsequently issued. The investigation fee shall be equal to the amount of the permit fee required by this code or the city fee schedule as applicable. The payment of such investigation fee shall not exempt the applicant from compliance with all other provisions of either this code or the technical codes nor from penalty prescribed by law.~~

~~**109.9 Unauthorized cover up fee.** Any work concealed without first obtaining the required inspection in violation of Section 110 shall be assessed a fee as established by the city fee schedule.~~

(Reason: This fee is not a fine or penalty but is designed to compensate for time and to remove incentive

~~to attempt to evade permits and code compliance. Text taken from former Uniform Administrative Code.)~~

****Section 110.3: change to read as follows:**

110.3 Required inspections. The Building Official, upon notification, shall make the inspections set forth in Sections 110.3.1 through 110.3.10. No inspections shall be made on new construction until the site has been surveyed and all property corners have been physically identified.

(Reason: To clarify existing requirement for site survey)

*****Section 110.3.5; Lath, gypsum board and gypsum panel product inspection; Delete exception**

~~**Exception:** Gypsum board and gypsum panel products that are not part of a fire resistance rated assembly or a shear assembly.~~

~~*(Reason: Lath or gypsum board inspections are not typically performed in this area.)*~~

****Section 113 Board of Appeals: Delete sections; change to read as follows:**

113.1 General. In order to hear and decide appeals of orders, decisions or determinations made by the Building Official relative to the application and interpretation of this code, there shall be and is hereby created a board of appeals.: ~~The board of appeals shall be appointed by the applicable governing authority and shall hold office at its pleasure. The board shall adopt rules of procedure for conducting its business.~~ Construction Advisory and Appeals Commission; see Chapter 2-6, of the Amarillo Municipal Code.

113.2 Limitations on authority. An application for appeal shall be based on a claim that the true intent of this code or the rules legally adopted there under have been incorrectly interpreted, the provisions of this code do not fully apply or an equally good or better form of construction is proposed. The board shall have no authority to waive requirements of this code.

113.3 Qualifications. The board of appeals shall consist of members who are qualified by experience and training to pass on matters pertaining to building construction and are not employees of the jurisdiction.

(Reason: Established Construction Advisory and Appeals Commission procedures)

*****Section 202; amend definition of Ambulatory Care Facility as follows:**

AMBULATORY CARE FACILITY. Buildings or portions thereof used to provide medical, surgical, psychiatric, nursing or similar care on a less than 24-hour basis to individuals who are rendered incapable of self-preservation by the services provided ~~or staff has accepted responsibility for care recipients already incapable.~~ This group may include but not be limited to the following:

- Dialysis centers
- Sedation dentistry
- Surgery centers
- Colonic centers
- Psychiatric centers

*(Reason: To clarify the range of uses included in the definition. Explanatory note related to **Ambulatory Care Facilities:** This group of uses includes medical or dental offices where persons are put under for dental surgery or other services. Section 903.2.2 will now require such uses to be sprinklered if on other than the floor of exit discharge or if four or more persons are put under on the level of exit discharge. Recommend (1.) jurisdictions document any pre-existing non-conforming conditions prior to issuing a new C of O for a change of tenant and, (2.) On any medical or dental office specify on C of O the maximum number of persons permitted to be put under general anesthesia. It is recommended that before a Certificate of Occupancy is issued, a letter of intended use from the business owner shall be included and a C of O documenting the maximum number of care recipient's incapable of self-preservation allowed.)*

*****Section 202; add definition of Assisting Living Facilities to read as follows.**

ASSISTED LIVING FACILITIES. A building or part thereof housing persons, on a 24-hour basis, who because of age, mental disability or other reasons, live in a supervised residential environment which provides personal care services. The occupants are capable of responding to an emergency situation without physical assistance from staff.

(Reason: The code references Assisted Living facilities and definition was deleted.)

*****Section 202; change definition of “Atrium” as follows:**

ATRIUM. An opening connecting ~~two~~ three or more stories... *{Balance remains unchanged}*

(Reason: Accepted practice in the region based on legacy codes. Section 1019 permits unenclosed two-story stairways under certain circumstances.)

****Section 202 Definitions: Insert; change to read as follows:**

NIGHTCLUB – a place of entertainment open at night, usually serving or allowing the consumption of alcoholic beverages, having a floor show, or providing music and space for dancing.

(Reason: To clarify terminology, interpretation and enforcement; provides consistency with Fire Code)

*****Section 202; add amend definition of “Repair Garage” as follows:**

REPAIR GARAGE. A building, structure or portion thereof used for servicing or repairing motor vehicles. This occupancy shall also include garages involved in minor repair, modification and servicing of motor vehicles for items such as lube changes, inspections, windshield repair or replacement, shocks, minor part replacement and other such minor repairs.

(Reason: The code references align with fire code.)

*****Section 202; amend definition of SPECIAL INSPECTOR to read as follows:**

~~**SPECIAL INSPECTOR.** A qualified person employed or retained by an approved agency who shall prove to the satisfaction of the registered design professional in responsible charge and approved by the Building Official as having the competence necessary to inspect a particular type of construction requiring special inspection.~~

(Reason: The registered design professional in responsible charge should be included.)

*****Section 202; amend definition to read as follows:**

HIGH-RISE BUILDING. A building with an occupied floor located more than ~~75~~ 55 feet (22,860 ~~mm~~) (16,764 mm) above the lowest level of fire department vehicle access.

(Reason: To define high-rise, as it influences sprinkler requirement thresholds based on the firefighting capabilities of a jurisdiction.)

*****Section 303.1.3; add a sentence to read as follows:**

~~**303.1.3 Associated with Group E occupancies.** A room or space used for assembly purposes that is associated with a Group E occupancy is not considered a separate occupancy, except when applying the assembly requirements of Chapters 10 and 11.~~

(Reason: To clarify that egress and accessibility requirements are applicable for assembly areas, i.e. cafeteria, auditoriums, etc.)

*****Section 304.1; add the following to the list of occupancies:**

Fire stations

Police stations with detention facilities for 5 or less

(Reason: Consistent with regional practice dating back to the legacy codes.)

*****Section 307.1.1; add the following sentence to Exception 4:**

4. Cleaning establishments... {Text unchanged} ...with Section 707 or 1-hour horizontal assemblies constructed in accordance with Section 711 or both. See also IFC Chapter 21, Dry Cleaning Plant provisions.

(Reason: To call attention to detailed requirements in the Fire Code.)

*****Section 403.1, Exception 3; change to read as follows:**

3. The open-air portion of a building {remainder unchanged}

(Reason: To clarify enclosed portions are not exempt.)

~~*****Section 403.3, Exception; delete item 2.**~~

~~*(Reason: To provide adequate fire protection to enclosed areas.)*~~

*****Section 403.3.2; change to read as follows:**

[F] 403.3.2 Water supply to required fire pumps. In buildings that are more than 420 250 feet (76.20 m) in building height, required fire pumps shall be supplied by connections to no fewer than two water mains located in different streets. Separate supply piping shall be provided between each connection to the water main and the pumps. Each connection and the supply piping between the connection and the pumps shall be sized to supply the flow and pressure required for the pumps to operate.

Exception: {No change to exception}

(Reason: The 2009 edition of the IFC added this requirement based on a need for redundancy of the water supply similar to the redundancy of the power supply to the fire pumps required for such tall buildings, partially due to the fact that these buildings are rarely fully evacuated in a fire event. More commonly, the alarm activates on the floor of the event, the floor above and the floor below. Back-up power to the fire pump becomes critical for this reason. Certainly, the power is pointless if the water supply is impaired for any reason, so a similar requirement is provided here for redundant water supplies. The 2015 edition changed the requirement to only apply to very tall buildings over 420 ft. This amendment modifies/lowers the requirement to 250 ft., based on this same height requirement for fire service access elevators. Again, the language from the 2009 and 2012 editions of the code applied to any high-rise building. This compromise at 120 ft. is based on the above technical justification of defend-in-place scenarios in fire incidents in such tall structures.)

*****Section 404.5; delete Exception.**

(Reason: Consistent with amended atrium definition.)

*****Section 406.3.3.1 Carport separation; add sentence to read as follows:**

A fire separation is not required between a Group R-2 and U carport provided that the carport is entirely open on all sides and that the distance between the two is at least 10 feet (3048 mm).

(Reason: Simplifies the fire separation distance and eliminates the need to obtain opening information on existing buildings when adding carports in existing apartment complexes. Consistent with legacy codes in effect in region for years and no record of problems with car fires spreading to apartments as a result.)

~~*****Table 506.2; delete sentence from table**~~

~~I.—The maximum allowable area for a single-story non-sprinklered Group U greenhouse is permitted to be 9000 square feet or the allowable area shall be permitted to comply with Table C102.1 of Appendix C.~~

~~*(Reason: To eliminate the need for Appendix C adoption and remain consistent with 6000-sq.-ft. sprinklering provision.)*~~

*****Section 506.3.1; add sentence to read as follows:**

506.3.1 Minimum percentage of perimeter. *{Existing text remains}*

In order to be considered as accessible, if not in direct contact with a street or fire lane, a minimum 10-foot wide pathway meeting fire department access from the street or approved fire lane shall be provided.

(Reason: To define what is considered accessible. Consistent with regional amendment to IFC 504.1.)

*****Section 602.1.1; add sentence to read as follows:**

602.1.1 Minimum Requirements. *{Existing text to remain}*

Where a building contains more than one distinct type of construction, the building shall comply with the most restrictive area, height, and stories, for the lesser type of construction or be separated by fire walls.

(Reason: To create definite language that requires separation between dissimilar building types.)

*****Section 708.4.2; change sentence to read as follows:**

708.4.2 Fireblocks and draftstops in combustible construction. *{Body of text unchanged}*

Exceptions:

1. Buildings equipped with an automatic sprinkler system installed throughout in accordance with Section 903.3.1.1, or in accordance with Section 903.3.1.2 provided that sprinkler protection is provided in the space between the top of the fire partition and the underside of the floor or roof sheathing, deck or slab above as required for systems complying with Section 903.3.1.1. Portions of buildings containing concealed spaces filled with noncombustible insulation as permitted for sprinkler omission shall not apply to this exception for draftstopping. *{Remainder unchanged}*

(Reason: The most common exception used to eliminate the need for sprinklers in concealed spaces of combustible construction is to fill the space with noncombustible insulation. This exception was changed in 2010 to permit a 2-inch air gap at the top of the filled space. A space compliant with the permitted omission above would allow hot gas and smoke to spread unimpeded throughout a building not provided with draftstopping. For this reason, omission of sprinklers permitted in accordance with NFPA 13 referenced standard should not be permitted with IBC exception requiring draftstopping in combustible construction.)

*****Section 718.3; change sentence to read as follows:**

718.3 Draftstopping in floors. *{Body of text unchanged}*

Exceptions: Buildings equipped throughout with an automatic sprinkler system in accordance with Section 903.3.1.1. and provided that in combustible construction, sprinkler protection is provided in the floor space.

(Reason: To remain consistent with changes in 708.4.2 code.)

*****Section 718.4; change sentence to read as follows:**

718.4 Draftstopping in attics. *{Body of text unchanged}*

Exceptions: Buildings equipped throughout with an automatic sprinkler system in accordance with Section 903.3.1.1 and provided that in combustible construction, sprinkler protection is provided in the attic space.

(Reason: To remain consistent with changes in 708.4.2 code.)

*****Section 901.6.1; add Section 901.6.1.1 to read as follows:**

901.6.1.1 Standpipe Testing. Building owners/managers must maintain and test standpipe systems as per NFPA 25 requirements. The following additional requirements shall be applied to the testing that is required every 5 years:

1. The piping between the Fire Department Connection (FDC) and the standpipe shall be backflushed or inspected by approved camera when foreign material is present or when caps are missing, and also hydrostatically tested for all FDC's on any type of standpipe system. Hydrostatic testing shall also be conducted in accordance with NFPA 25 requirements for the different types of standpipe systems.
2. For any manual (dry or wet) standpipe system not having an automatic water supply capable of flowing water through the standpipe, the tester shall connect hose from a fire hydrant or portable pumping system (as approved by the Fire Code Official) to each FDC, and flow water through the standpipe system to the roof outlet to verify that each inlet connection functions properly. Confirm that there are no open hose valves prior to introducing water into a dry standpipe. There is no required pressure criteria at the outlet. Verify that check valves function properly and that there are no closed control valves on the system.
3. Any pressure relief, reducing, or control valves shall be tested in accordance with the requirements of NFPA 25. All hose valves shall be exercised.
4. If the FDC is not already provided with approved caps, the contractor shall install such caps for all FDC's as required by the Fire Code Official.
5. Upon successful completion of standpipe test, place a blue tag (as per Texas Administrative Code, Fire Sprinkler Rules for Inspection, Test and Maintenance Service (ITM) Tag) at the bottom of each standpipe riser in the building. The tag shall be check-marked as "Fifth Year" for Type of ITM, and the note on the back of the tag shall read "5 Year Standpipe Test" at a minimum.
6. The procedures required by Texas Administrative Code Fire Sprinkler Rules with regard to Yellow Tags and Red Tags or any deficiencies noted during the testing, including the required notification of the local Authority Having Jurisdiction (Fire Code Official) shall be followed.
7. Additionally, records of the testing shall be maintained by the owner and contractor, if applicable, as required by the State Rules mentioned above and NFPA 25.
8. Standpipe system tests where water will be flowed external to the building shall not be conducted during freezing conditions or during the day prior to expected nighttime freezing conditions.
9. Contact the Fire Code Official for requests to remove existing fire hose from Class II and III standpipe systems where employees are not trained in the utilization of this firefighting equipment. All standpipe hose valves must remain in place and be provided with an approved cap and chain when approval is given to remove hose by the Fire Code Official.

(Reason: Increases the reliability of the fire protection system and re-emphasizes the requirements of NFPA 25 relative to standpipe systems, as well as ensuring that FDC connections are similarly tested/maintained to ensure operation in an emergency incident.)

*****Section 903.1.1; change to read as follows:**

~~**903.1.1 Alternative Protection.** Alternative automatic fire-extinguishing systems complying with Section 904 shall be permitted instead of in addition to automatic sprinkler protection where recognized by the applicable standard and, or as approved by the Fire Code Official.~~

~~*(Reason: Such alternative systems do not provide the reliability of automatic sprinkler protection. Most gaseous type systems are highly susceptible to open doors, ceiling or floor tile removal, etc. However, an applicant could pursue an Alternate Method request to help mitigate the reliability issues with these alternative systems with the fire code official if so desired, or there may be circumstances in which the fire code official is acceptable to allowing an alternate system in lieu of sprinklers, such as kitchen hoods or paint booths.)*~~

*****Section 903.2; add paragraph to read as follows: ~~and delete the exception:~~**

Automatic sprinklers shall not be installed in elevator machine rooms, elevator machine spaces, and elevator hoistways, other than pits where such sprinklers would not necessitate shunt trip requirements under any circumstances. Storage shall not be allowed within the elevator machine room. Signage shall be provided at the entry doors to the elevator machine room indicating "ELEVATOR MACHINERY – NO STORAGE ALLOWED."

(Reason: Firefighter and public safety. This amendment eliminates the shunt trip requirement of the International Building Code Section 3005.5 for the purpose of elevator passenger and firefighter safety. This amendment is contingent on the Building Code amendment eliminating the Exceptions to Section 3005.4, such that passive fire barriers for these areas are maintained. The exception deletion is due to the fact that such telecom areas pose an undue fire risk to the structural integrity of the building.)

*****Section 903.2.9; add Section 903.2.9.3 to read as follows:**

~~**903.2.9.3 Self-Service Storage Facility.** An automatic sprinkler system shall be installed throughout all self-service storage facilities.~~

~~*(Reason: Fire departments are unable to inspect these commercial occupancies and are unaware of the contents being stored. Previous allowance to separate units by fire barriers is difficult to enforce maintenance after opening.)*~~

*****Section 903.2.11; change 903.2.11.3 and add 903.2.11.7 and 903.2.11.8, ~~and 903.2.11.9~~ as follows:**

903.2.11.3 Buildings 55 Feet or more in Height. An automatic sprinkler system shall be installed throughout buildings that have one or more stories ~~with an occupant load of 30 or more, other than penthouses in compliance with Section 1510 of the International Building Code,~~ located 55 feet (16 764 mm) or more above the lowest level of fire department vehicle access, measured to the finished floor.

Exceptions:

4. Open parking structures in compliance with Section 406.5 of the International Building Code, having no other occupancies above the subject garage.
2. Occupancies in Group F-2.

903.2.11.7 High-Piled Combustible Storage. For any building with a clear height exceeding 12 feet (4,572 mm), see Chapter 32 to determine if those provisions apply.

903.2.11.8 Spray Booths and Spray Rooms. New and existing spray booths and spraying rooms shall be protected by an approved automatic fire-extinguishing system. ~~Existing spray booths or spray rooms that are not already equipped with an approved automatic fire suppression system will be required to come into compliance by January 1, 2023.~~

~~**903.2.11.9 Buildings Over 6,000 sq. ft.** An automatic sprinkler system shall be installed throughout all buildings with a building area 6,000 sq. ft. or greater and in all existing buildings that are enlarged to be 6,000 sq. ft. or greater. For the purpose of this provision, fire walls shall not define separate buildings.~~

Exception: Open parking garages in compliance with Section 406.5 of the International Building Code.

(Reason: Provides jurisdictions options as to their desired level of sprinkler protection based on multiple factors including firefighting philosophies/capabilities.)

*****Section 903.3.1.1.1; change to read as follows:**

903.3.1.1.1 Exempt Locations. When approved by the Fire Code Official, automatic sprinklers shall not be required in the following rooms or areas where such ... *{text unchanged}* ... because it is damp, of fire-resistance-rated construction or contains electrical equipment.

1. Any room where the application of water, or flame and water, constitutes a serious life or fire hazard.
2. Any room or space where sprinklers are considered undesirable because of the nature of the contents, when approved by the fire code official.
3. Generator and transformer rooms, under the direct control of a public utility, separated from the remainder of the building by walls and floor/ceiling or roof/ceiling assemblies having a fire-resistance rating of not less than 2 hours.
4. ~~In rooms or areas that are of noncombustible construction with wholly noncombustible contents.~~
5. Fire service access—Elevator machine rooms, and machinery spaces, and hoistways, other than pits where such sprinklers would not necessitate shunt trip requirements under any circumstances.
6. *{Delete}*

(Reason: Gives clarification. Exception 4 deleted to provide protection where fire risks are poorly addressed. Amendment 903.2 addresses Exception 5 above relative to the elimination of sprinkler protection in these areas to avoid the shunt trip requirement.)

~~*Section 903.3.1.2.3; delete sections and replace as follows:~~**

~~[F] Section 903.3.1.2.3 Attached Garages and Attics.~~ ~~Sprinkler protection is required in attached garages, and in the following attic spaces:~~

1. ~~*{Remainder of text unchanged}*~~
2. ~~*{Remainder of text unchanged}*~~
3. ~~Attic spaces of buildings that are two or more stories in height above grade plane or above the lowest level of fire department vehicle access.~~
4. ~~Group R-4, Condition 2 occupancy attics not required by Item 1 or 3 to have sprinklers shall comply with one of the following:~~
 - ~~*{Remainder of text unchanged}*~~

(Reason: Attic protection is required due to issues with fire exposure via soffit vents, as well as firefighter safety. Several jurisdictions indicated experience with un-protected attic fires resulting in displacement of all building occupants. NFPA 13 provides for applicable attic sprinkler protection requirements, as well as exemptions to such, based on noncombustible construction, etc. Attached garages already require sprinklers via NFPA 13R—this amendment just re-emphasizes the requirement.)

*****Section 903.3.1.3; change to read as follows:**

903.3.1.3 NFPA 13D Sprinkler Systems. Automatic sprinkler systems installed in one- and two-family dwellings; Group R-3; Group R-4, Condition 1; and townhouses shall be permitted to be installed throughout in accordance with NFPA 13D or in accordance with state law.

(Reason: To allow the use of the Plumbing section of the International Residential Code (IRC) and recognize current state stipulations in this regard.)

*****Section 903.3.1.4; add to read as follows:**

[F] 903.3.1.4 Freeze protection. Freeze protection systems for automatic fire sprinkler systems shall be in accordance with the requirements of the applicable referenced NFPA standard and this section.

903.3.1.4.1 Attics. Only dry pipe, preaction, or listed antifreeze automatic fire sprinkler systems shall be allowed to protect attic spaces.

Exception: Wet-pipe fire sprinkler systems shall be allowed to protect non-ventilated attic spaces where:

1. The attic sprinklers are supplied by a separate floor control valve assembly to allow ease of draining the attic system without impairing sprinklers throughout the rest of the building, and
2. Adequate heat shall be provided for freeze protection as per the applicable referenced NFPA standard, and
3. The attic space is a part of the building's thermal, or heat, envelope, such that insulation is provided at the roof deck, rather than at the ceiling level.

903.3.1.4.2 Heat trace/insulation. Heat trace/insulation shall only be allowed where approved by the Fire Code Official for small sections of large diameter water-filled pipe.

(Reason: In the last few years, severe winters brought to light several issues with current practices for sprinklering attics, not the least of which was wet-pipe sprinklers in ventilated attics provided with space heaters, etc. for freeze protection of such piping. This practice is not acceptable for the protection of water-filled piping in a ventilated attic space as it does not provide a reliable means of maintaining the minimum 40 degrees required by NFPA, wastes energy, and presents a potential ignition source to the attic space. Listed antifreeze is specifically included because NFPA currently allows such even though there is no currently listed antifreeze at the time of development of these amendments. The intent of this amendment is to help reduce the large number of freeze breaks that have occurred in the past with water-filled wet-pipe sprinkler systems in the future, most specifically in attic spaces.)

*****Section 903.3.5; add a second paragraph to read as follows:**

Water supply as required for such systems shall be provided in conformance with the supply requirements of the respective standards; however, every water-based fire protection system shall be designed with a 10 psi safety factor. Reference Section 507.4 for additional design requirements.

(Reason: To define uniform safety factor for the region.)

*****Section 903.4; add a second paragraph after the exceptions to read as follows:**

Sprinkler and standpipe system water-flow detectors shall be provided for each floor tap to the sprinkler system and shall cause an alarm upon detection of water flow for more than 45 seconds. All control valves in the sprinkler and standpipe systems except for fire department hose connection valves shall be electrically supervised to initiate a supervisory signal at the central station upon tampering.

(Reason: To avoid significant water losses. Consistent with amendment to IFC 905.9.)

*****Section 903.4.2; add second paragraph to read as follows:**

The alarm device required on the exterior of the building shall be a weatherproof horn/strobe notification appliance with a minimum 75 candela strobe rating, installed as close as practicable to the fire department connection.

(Reason: Fire department connections are not always located at the riser; this allows the fire department faster access.)

*****Section 905.2; change to read as follows:**

905.2 Installation Standard. Standpipe systems shall be installed in accordance with this section and NFPA 14. Fire department connections for standpipe systems shall be in accordance with Section 912. Manual dry standpipe systems shall be supervised with a minimum of 10 psig and a maximum of 40 psig air pressure with a high/low alarm.

(Reason: To define manual dry standpipe supervision requirements. Helps ensure the integrity of the standpipe system via supervision, such that open hose valves will result in a supervisory low air alarm.)

*****Section 905.3; add Section 905.3.9 and exception to read as follows:**

905.3.9 Buildings Exceeding ~~10,000~~ 12,000 sq. ft. In buildings exceeding ~~10,000~~ 12,000 square feet (~~1,115 m²~~) in area per story and where any portion of the building's interior area is more than 200 feet (60,960 mm) of travel, vertically and horizontally, from the nearest point of fire department vehicle access, Class I automatic wet or manual wet standpipes shall be provided.

Exceptions:

1. Automatic dry, semi-automatic dry, and manual dry standpipes are allowed as provided for in NFPA 14 where approved by the Fire Code Official.
2. R-2 occupancies of four stories or less in height having no interior corridors.

(Reason: Allows for the rapid deployment of hose lines to the body of the fire. Manual dry option added this edition.)

*****Section 905.4, change items 1, 3, and 5, and add item 7 to read as follows:**

1. In every required ~~interior~~ exit stairway, a hose connection shall be provided for each story above and below grade plane. Hose connections shall be located at the main floor landing between stories, unless otherwise approved by the Fire Code Official.
2. *{Remainder of text unchanged}*
3. In every exit passageway, at the entrance from the exit passageway to other areas of a building.

Exception: Where floor areas adjacent to an exit passageway are reachable from an ~~interior~~ exit stairway hose connection by a *{Remainder of text unchanged}*

4. *{Remainder of text unchanged}*
5. Where the roof has a slope less than four units vertical in 12 units horizontal (33.3-percent slope), each standpipe shall be provided with a two-way a-hose connection shall be located to serve the roof or at the highest landing of an ~~interior~~ exit stairway with stair access to the roof provided in accordance with Section 1011.12.
6. *{Remainder of text unchanged}*
7. When required by this Chapter, standpipe connections shall be placed adjacent to all required exits to the structure and at two hundred feet (200') intervals along major corridors thereafter, or as otherwise approved by the Fire Code Official.

(Reason: Item 1, 3, and 5 amendments to remove 'interior' will help to clarify that such connections are required for all 'exit' stairways, to ensure firefighter capabilities are not diminished in these tall buildings, simply because the stair is on the exterior of the building. Item 5 reduces the amount of pressure required to facilitate testing and provides backup protection for fire fighter safety. Item 7 allows for the rapid deployment of hose lines to the body of the fire.)

*****Section 905.9; add a second paragraph after the exceptions to read as follows:**

Sprinkler and standpipe system water-flow detectors shall be provided for each floor tap to the sprinkler system and shall cause an alarm upon detection of water flow for more than 45 seconds. All control valves in the sprinkler and standpipe systems except for fire department hose connection valves shall be electrically supervised to initiate a supervisory signal at the central station upon tampering.

(Reason: To avoid significant water losses. Consistent with amendment to IFC 903.4.)

****Section 907.1; add Section 907.1.4 to read as follows:**

907.1.4 Design Standards. ~~Where a new fire alarm system is installed, the devices shall be addressable. Fire alarm systems utilizing more than 20 smoke detectors shall have analog initiating devices. Where a~~

new fire alarm system is installed with more than 20 initiating devices, the devices shall be addressable type devices.

(Reason: Provides for the ability of descriptive identification of alarms and reduces need for panel replacement in the future. Updated wording to match the language of the new requirement at 907.5.2.3. Change of terminology allows for reference back to definitions of NFPA 72.)

****Section 907.2.1; change to read as follows:**

907.2.1 Group A. A manual fire alarm system that activates the occupant notification system in accordance with Section 907.5 shall be installed in Group A occupancies ~~where the~~ having an occupant load ~~due to the assembly occupancy is~~ of 300 or more persons, or where the Group A occupant load is more than 100 persons above or below the lowest level of exit discharge. Group A occupancies not separated from one another in accordance with Section 707.3.10 of the International Building Code shall be considered as a single occupancy for the purposes of applying this section. Portions of Group E occupancies occupied for assembly purposes shall be provided with a fire alarm system as required for the Group E occupancy.

Exception: *{Remainder of text unchanged}*

Activation of fire alarm notification appliances shall:

1. Cause illumination of the means of egress with light of not less than 1 foot-candle (11 lux) at the walking surface level, and
2. Stop any conflicting or confusing sounds and visual distractions.
3. Activation of a pre-recorded message clearly audible throughout the building when occupant load is over 1,000 people.

(Reason: Increases the requirement to be consistent with Group B requirement. Also addresses issue found in Group A occupancies of reduced lighting levels and other A/V equipment that distracts from fire alarm notification devices or reduces ability of fire alarm system to notify occupants of the emergency condition.)

*****Section 907.2.3; change to read as follows:**

907.2.3 Group E. A manual fire alarm system that initiates the occupant notification signal utilizing an emergency voice/alarm communication system meeting the requirements of Section 907.5.2.2 and installed in accordance with Section 907.6 shall be installed in Group E educational occupancies. When automatic sprinkler systems or smoke detectors are installed, such systems or detectors shall be connected to the building fire alarm system. An approved smoke detection system shall be installed in Group E day care occupancies. Unless separated by a minimum of 100' open space, all buildings, whether portable buildings or the main building, will be considered one building for alarm occupant load consideration and interconnection of alarm systems.

Exceptions:

1. *{Remainder of text unchanged}*
 - 1.1. Residential In-Home day care with not more than 12 children may use interconnected single station detectors in all habitable rooms. (For care of more than five children 2 1/2 or less years of age, see Section 907.2.6.) *{No change to remainder of exceptions}*

(Reason: To distinguish educational from day care occupancy minimum protection requirements. Further, to define threshold at which portable buildings are considered a separate building for the purposes of alarm systems. Exceptions provide consistency with State law concerning such occupancies.)

*****Section 907.2.12, Exception 3; change to read as follows:**

3. Open air portions of buildings with an occupancy in Group A-5 in accordance with Section 303.1 of the International Building Code; however, this exception does not apply to accessory uses including but not limited to sky boxes, restaurants, and similarly enclosed areas.

(Reason: To indicate that enclosed areas within open air seating type occupancies are not exempted from automatic fire alarm system requirements.)

*****Section 907.4.2; add Section 907.4.2.7 to read as follows:**

907.4.2.7 Type. Manual alarm initiating devices shall be an approved double action type.

(Reason: Helps to reduce false alarms.)

*****Section 907.6.1; add Section 907.6.1.1 to read as follows:**

~~907.6.1.1 Wiring Installation. All fire alarm systems shall be installed in such a manner that a failure of any single initiating device or single open in an initiating circuit conductor will not interfere with the normal operation of other such devices. All signaling line circuits (SLC) shall be installed in such a way that a single open will not interfere with the operation of any addressable devices (Class A). Outgoing and return SLC conductors shall be installed in accordance with NFPA 72 requirements for Class A circuits and shall have a minimum of four feet separation horizontal and one foot vertical between supply and return circuit conductors. The initiating device circuit (IDC) from a signaling line circuit interface device may be wired Class B, provided the distance from the interface device to the initiating device is ten feet or less.~~

~~*(Reason: To provide uniformity in system specifications and guidance to design engineers. Improves reliability of fire alarm devices and systems.)*~~

*****Section 907.6.3; delete all four Exceptions.**

(Reason: To assist responding personnel in locating the emergency event for all fire alarm systems.)

*****Section 907.6.6; add sentence at end of paragraph to read as follows:**

See 907.6.3 for the required information transmitted to the supervising station.

(Reason: To assist responding personnel in locating the emergency event for all fire alarm systems.)

****Section 910.2; change Exception 2 and 3 to read as follows:**

2. Only manual smoke and heat removal shall ~~not~~ be required in areas of buildings equipped with early suppression fast-response (ESFR) sprinklers. Automatic smoke and heat removal is prohibited.
3. Only manual smoke and heat removal shall ~~not~~ be required in areas of buildings equipped with control mode special application sprinklers with a response time index of $50(m^*S)^{1/2}$ or less that are listed to control a fire in stored commodities with 12 or fewer sprinklers. Automatic smoke and heat removal is prohibited.

(Reason: Allows the fire department to control the smoke and heat during and after a fire event, while still prohibiting such systems from being automatically activated, which is a potential detriment to the particular sprinkler systems indicated.)

*****Section 910.2; add subsections 910.2.3 with exceptions to read as follows:**

910.2.3 Group H. Buildings and portions thereof used as a Group H occupancy as follows:

1. In occupancies classified as Group H-2 or H-3, any of which are more than ~~45,000~~ 12,000 square feet (~~4,394~~ 1,115 m²) in single floor area.

Exception: Buildings of noncombustible construction containing only noncombustible materials.

2. In areas of buildings in Group H used for storing Class 2, 3, and 4 liquid and solid oxidizers, Class 1 and unclassified detonable organic peroxides, Class 3 and 4 unstable (reactive)

materials, or Class 2 or 3 water-reactive materials as required for a high-hazard commodity classification.

Exception: Buildings of noncombustible construction containing only noncombustible materials.

(Reason: Maintains a fire protection device utilized in such occupancies where it is sometimes necessary to allow chemicals to burn out, rather than extinguish.)

*****Section 910.3; add section 910.3.4 to read as follows:**

910.3.4 Vent Operation. Smoke and heat vents shall be capable of being operated by approved automatic and manual means. Automatic operation of smoke and heat vents shall conform to the provisions of Sections 910.3.2.1 through 910.3.2.3.

910.3.4.1 Sprinklered buildings. Where installed in buildings equipped with an approved automatic sprinkler system, smoke and heat vents shall be designed to operate automatically. The automatic operating mechanism of the smoke and heat vents shall operate at a temperature rating at least 100 degrees F (approximately 38 degrees Celsius) greater than the temperature rating of the sprinklers installed.

Exception: Manual only systems per Section 910.2.

910.3.4.2 Nonsprinklered Buildings. Where installed in buildings not equipped with an approved automatic sprinkler system, smoke and heat vents shall operate automatically by actuation of a heat-responsive device rated at between 100°F (56°C) and 220°F (122°C) above ambient.

Exception: Listed gravity-operated drop out vents.

(Reason: Amendment continues to keep applicable wording from prior to the 2012 edition of the IFC. Specifically, automatic activation criteria is no longer specifically required in the published code. Specifying a temperature range at which smoke and heat vents should activate in sprinklered buildings helps to ensure that the sprinkler system has an opportunity to activate and control the fire prior to vent operation.)

*****Section 910.4.3.1; change to read as follows:**

910.4.3.1 Makeup Air. Makeup air openings shall be provided within 6 feet (1829 mm) of the floor level. Operation of makeup air openings shall be manual or automatic. The minimum gross area of makeup air inlets shall be 8 square feet per 1,000 cubic feet per minute (0.74 m² per 0.4719 m³/s) of smoke exhaust.

(Reason: Makeup air has been required to be automatic for several years now in this region when mechanical smoke exhaust systems are proposed. This allows such systems to be activated from the smoke control panel by first responders without having to physically go around the exterior of the building opening doors manually. Such requires a significant number of first responders on scene to conduct this operation and significantly delays activation and/or capability of the smoke exhaust system.)

*****Section 912.2; add Section 912.2.3 to read as follows:**

912.2.3 Hydrant Distance. An approved fire hydrant shall be located within 100 feet of the fire department connection as the fire hose lays along an unobstructed path. ~~The fire department connection shall be located within 100 feet of an approved fire hydrant as the fire hose lays along an approved unobstructed path.~~

(Reason: To accommodate limited hose lengths, improve response times where the FDC is needed to achieve fire control, and improve ease of locating a fire hydrant in those situations also. Also, consistent with NFPA 14 criteria.)

*****Section 913.2.1; add Section 913.2.1.1 and exception to read as follows:**

913.2.1.1 Fire Pump Room Access. When located on the ground level at an exterior wall, the fire pump room shall be provided with an exterior fire department access door that is not less than 3 ft. in width and 6 ft. – 8 in. in height, regardless of any interior doors that are provided. A key box shall be provided at this door, as required by IFC Section 506.1.

Exception: When it is necessary to locate the fire pump room on other levels or not at an exterior wall, the corridor leading to the fire pump room access from the exterior of the building shall be provided with equivalent fire resistance as that required for the pump room, or as approved by the Fire Code Official. Access keys shall be provided in the key box as required by IFC Section 506.1.

(Reason: This requirement allows fire fighters safer access to the fire pump room. The requirement allows access without being required to enter the building and locate the fire pump room interior access door during a fire event. The exception recognizes that this will not always be a feasible design scenario for some buildings, and as such, provides an acceptable alternative to protect the pathway to the fire pump room.)

*****Section 1006.2.2.7; add Section 1006.2.2.7 as follows:**

1006.2.2.7 Electrical Rooms. For electrical rooms, special exiting requirements may apply. Reference the electrical code as adopted.

(Reason: Cross reference necessary for coordination with the NEC which has exiting requirements as well.)

*****Section 1009.8; add the following Exception 7:**

1009.8 Two Way Communication. A two-way communication system complying with Sections 1009.8.1 and 1009.8.2 shall be provided at the landing serving each elevator required to be accessible on each accessible floor that is one or more stories above or below the level of exit discharge.

Exceptions:

7. Buildings regulated under State Law and built in accordance with State registered plans, including variances or waivers granted by the State, shall be deemed to be in compliance with the requirements of Section 1009 and chapter 11.

(Reason: To accommodate buildings regulated under Texas State Law and to be consistent with amendments in Chapter 11.)

*****Section 1010.1.9.5 Bolt Locks; amend exceptions 3 and 4 as follows:**

Exceptions:

3. Where a pair of doors serves an occupant load of less than 50 persons in a Group B, F, M or S occupancy. *{Remainder of text unchanged}*
4. Where a pair of doors serves a Group A, B, F, M or S occupancy *{Remainder of text unchanged}*

(Reason: Application to M occupancies reflects regional practice; No. 4 expanded to Group A due to it being a similar scenario to other uses; No. 4 was regional practice.)

*****Section 1020.1 Construction; add exception 6 to read as follows:**

6. In group B occupancies, corridor walls and ceilings need not be of fire-resistive construction within a single tenant space when the space is equipped with approved automatic smoke-detection within the corridor. The actuation of any detector must activate self-annunciating alarms audible in all areas within the corridor. Smoke detectors must be connected to an approved automatic fire alarm system where such system is provided.

(Reason: Regionally accepted alternate method.)

*****Section 1029.1.1.1 Spaces under grandstands and bleachers; delete this section.**

(Reason: Unenforceable.)

*****Section 1101.1 Scope; add exception to Section 1101.1 as follows:**

Exception: Components of projects regulated by and registered with Architectural Barriers Division of Texas Department of Licensing and Regulation shall be deemed to be in compliance with the requirements of this chapter.

(Reason: To accommodate buildings regulated under state law. Further clarified in 2015 to mean components that are specifically addressed by TDLR shall be exempt.)

****Section 1503.4.4; Add subsection; change to read as follows:**

1503.4.4 Drainage across adjacent properties: No roof drainage or surface drainage shall drain onto adjacent properties except where an engineered drainage plan calls for drainage across properties, and the appropriate drainage easements have been recorded in the deed records, and the necessary physical measures for protection of the adjacent properties have been installed.

(Reason: To provide requirements to prevent unauthorized drainage across adjacent property lines)

****Section 1507.8.1 change to read as follows:**

1507.8.1 Deck requirements. Wood shingles shall be used only on solid or spaced sheathing. Where spaced sheathing is used, sheathing boards shall not be less than 1-inch by 4-inch (25mm by 102 mm) nominal dimensions and shall be spaced on centers equal to the weather exposure to coincide with the placement of fasteners.

(Reason: Due to the wind and blowing snow in the Panhandle, there is greater potential for wind driven snow blows between the shingles and into the attic area.)

****Section 1507.9.1; change to read as follows:**

1507.9.1 Deck requirements. Wood shakes shall be used only on solid or spaced sheathing. Where spaced sheathing is used, sheathing boards shall not be less than 1-inch by 4-inch (25mm by 102 mm) nominal dimensions and shall be spaced on centers equal to the weather exposure to coincide with the placement of fasteners. Where 1-inch by 4-inch (25 mm by 102 mm) spaced sheathing is installed at 10 inches (254 mm) on center, additional 1-inch by 4-inch (25 mm by 102 mm) boards shall be installed between the sheathing boards.

(Reason: Due to the wind and blowing snow in the Panhandle, wind driven snow blows between the shingles and into the attic area.)

****Table 1507.9.6 amended as follows:**

TABLE 1507.9.6 WOOD SHAKE MATERIAL REQUIREMENTS

| MATERIAL | MINIMUM GRADES | APPLICABLE GRADING RULES |
|---|-----------------------|---|
| Wood shakes of naturally durable wood | 1 | Cedar Shake and Shingle Bureau |
| Taper sawn shakes and shingles of naturally durable wood | 1 or 2 | Cedar Shake and Shingle Bureau |
| Preservative-treated shakes and shingles of naturally durable wood | 1 | Cedar Shake and Shingle Bureau |
| Fire-retardant-treated shakes of naturally durable wood | 1 | Cedar Shake and Shingle Bureau |
| Preservative-treated taper sawn shakes of Southern pine treated in accordance with AWPAs Standard U1 (Commodity Specification A, Use Category 3B and section 5.6) | 1 or 2 | Forest Products Laboratory of the Texas Forest Services |

(Reason: modified for local blowing snow conditions)

****Section 1511.1; clarification; change to read as follows:**

1511.1 General. Materials and methods of application used for re-covering or replacing an existing roof covering shall comply with the requirements of Chapter 9, including but not limited to decking, flashing, and ventilation.


(Reason: Due to national insurance companies' failure to interpret reroofing roofing requirements are the same as new.)

****Section 1511.3.1.1; insert Figure 1511.3.1.1; change to read as follows:**

1511.3.1.1 Exceptions. A roof recover shall not be permitted where any of the following conditions occur:

1. Where the existing roof or roof covering is water-soaked or has deteriorated to the point that the existing roof or roof covering is not adequate as a base for additional roofing.
2. Where the existing roof covering is wood shake, slate, clay, cement or asbestos-cement tile.
3. Where the existing roof has two or more applications of any type of roof covering.
4. For asphalt shingles, when the building is located in an area subject to moderate or severe hail exposure according to Figure 1511.3.1.1.

FIGURE 1511.3.1.1 HAIL EXPOSURE MAP

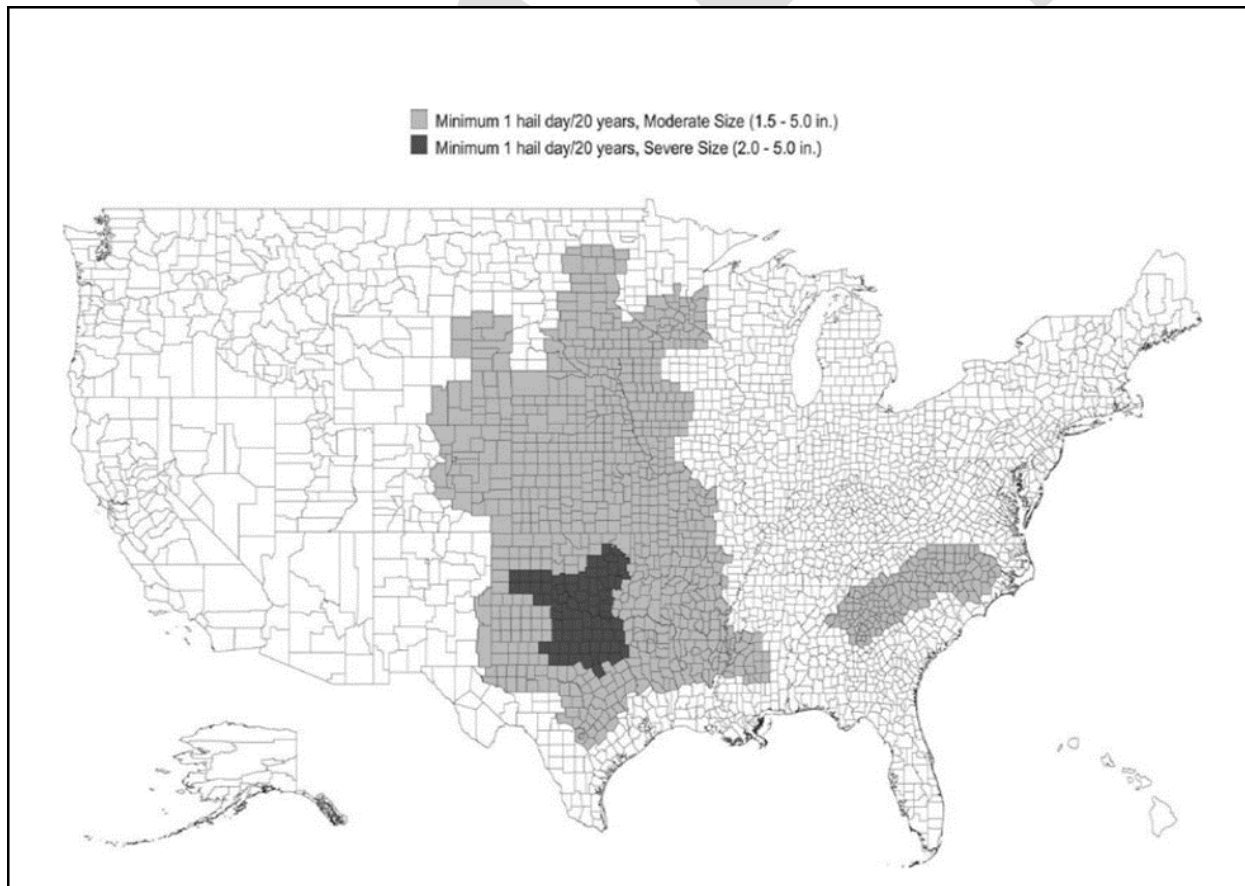

(Reason: Due to the of weather in the Panhandle, wind and hail damage is more prone when asphalt shingles used for re-covering; contractors unable to verify if any of the decking may need to be replaced and unable to verify the flashing integrity)

****Table 1604.1; Insert the following table as follows:**

TABLE 1604.1 CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA

| GROUND SNOW LOAD | WIND DESIGN | | | SEISMIC DESIGN CATEGORY | SUBJECT TO DAMAGE FROM Frost line | | | WINTER DESIGN TEMP | ICE BARRIER UNDERLAYMENT REQUIRED | FLOOD HAZARD | AIR FREEZING INDEX | MEAN ANNUAL TEMP | |
|-------------------|--------------------|---------------------|--------------------------|-------------------------|-----------------------------------|------------|-------|--------------------|-----------------------------------|--------------|--------------------|------------------|---------|
| | Speed | Topographic effects | Special wind debris zone | | Wind-borne debris zone | Weathering | depth | | | | | | Termite |
| 20 _{psf} | 115 _{mph} | NO | NO | NO | B | Moderate | 18" | Moderate to heavy | 20° | NO | AMC 4-8 | 311 | 57.2° |

(Reason: To provide a convenient method of locating local climatic and geographic design criteria)

*****Section 2901.1; add a sentence to read as follows:**

[P] 2901.1 Scope. *{Existing text to remain}* The provisions of this Chapter are meant to work in coordination with the provisions of Chapter 4 of the International Plumbing Code. Should any conflicts arise between the two chapters, the Building Official shall determine which provision applies.

(Reason: Gives Building Official discretion.)

*****Section 2902.1; add a second paragraph to read as follows:**

In other than E Occupancies, the minimum number of fixtures in Table 2902.1 may be lowered, if requested in writing, by the applicant stating reasons for a reduced number and approved by the Building Official.

(Reason: To allow flexibility for designer to consider specific occupancy needs.)

*****Table 2902.1; add footnote g to read as follows:**

- g. Drinking fountains are not required in M Occupancies with an occupant load of 100 or less, B Occupancies with an occupant load of 25 or less, and for dining and/or drinking establishments.

(Reason: Adjustment meets the needs of specific occupancy types.)

*****Add new Section 2902.1.4 to read as follows:**

~~**2902.1.4 Additional fixtures for food preparation facilities.** In addition to the fixtures required in this Chapter, all food service facilities shall be provided with additional fixtures set out in this section.~~

~~**2902.1.4.1 Hand washing lavatory.** At least one hand washing lavatory shall be provided for use by employees that is accessible from food preparation, food dispensing and ware washing areas. Additional hand washing lavatories may be required based on convenience of use by employees.~~

~~**2902.1.4.2 Service sink.** In new or remodeled food service establishments, at least one service sink or one floor sink shall be provided so that it is conveniently located for the cleaning of mops or similar wet floor cleaning tool and for the disposal of mop water and similar liquid waste. The location of the service sink(s) and/or mop sink(s) shall be approved by the City of Amarillo Environmental Health Department.~~

~~*(Reason: Coordinates Health law requirements with code language for consistent regional practice.)*~~

*****Section 2902; add Section 2902.1.4 to read as follows:**

2902.1.4 Additional requirements for food establishments and vended water or ice. Refer to City of Amarillo Ordinance No. 7703 and Chapter 8-5, Article IV, Section 8-5-21 of the Amarillo Municipal Code.

(Reason: Coordinates with local City of Amarillo Environmental Health ordinance and requirements with code language consistent with regional practice.)

*****Section 3001.2 Emergency Elevator Communication Systems for the deaf, hard of hearing and speech impaired; delete this section.**

(Reason: Per Elevator manufacturers input, they were not consulted prior to code approval and technology of elevator provisions as submitted are not currently available to provide this feature.)

*****Section 3002.1 Hoistway Enclosure Protection required. Add exceptions to Section 3002.1 as follows:**

Exceptions:

4. Elevators completely located within atriums shall not require hoistway enclosure protection.
5. Elevators in open or enclosed parking garages that serve only the parking garage, shall not require hoistway enclosure protection.

(Reason: Provides specific Code recognition that elevators within atriums and within parking garages do not require hoistway enclosure protection. Amendment needed since specific Code language does not currently exist.)

*****Section 3005.4 Machine rooms, control rooms, machinery spaces and control spaces; delete text as follows:**

~~Elevator machine rooms, control rooms, control spaces and machinery spaces outside of but attached to a hoistway that have openings into the hoistway shall be enclosed with fire barriers constructed in accordance with Section 707 or horizontal assemblies constructed in accordance with Section 711, or both.~~

Revise text to read:

Elevator machine rooms, control rooms, control spaces and machinery spaces shall be enclosed with fire barriers constructed in accordance with Section 707 or horizontal assemblies constructed in accordance with Section 711, or both.

{Remainder of text unchanged}

(Reason: This amendment eliminates code language to be consistent with the regional goal to require passive enclosures of these areas unless a hoistway enclosure is not required by other Code provisions. See companion change to eliminate fire sprinklers thereby eliminating shunt trip.)

*****Section 3005.4 Machine rooms, control rooms, machinery spaces and control spaces; Delete exceptions and add two new exceptions to Section 3005.4 as follows:**

Exceptions:

1. Elevator machine rooms, control rooms, machinery spaces and control spaces completely located within atriums shall not require enclosure protection.
2. Elevator machine rooms, control rooms, machinery spaces and control spaces in open or enclosed parking garages that serve only the parking garage, shall not require enclosure protection.

(Reason: This amendment eliminates the Exceptions to Section 3005.4 such that passive enclosures for these areas are to be provided and maintained. The fire rating of these enclosures is permitted to be omitted by the above added exceptions where allowed by other provisions of the code such as in atriums and parking structures. See companion change to eliminate fire sprinklers to eliminate the need for shunt trip system.)

*****Section 3005.7 add a Section 3005.7 as follows:**

3005.7 Fire Protection in Machine rooms, control rooms, machinery spaces and control spaces.

3005.7.1 Automatic sprinkler system. The building shall be equipped throughout with an automatic sprinkler system in accordance with Section 903.3.1.1, except as otherwise permitted by Section 903.3.1.1.1 and as prohibited by Section 3005.7.2.1.

3005.7.2.1 Prohibited locations. Automatic sprinklers shall not be installed in machine rooms, elevator machinery spaces, control rooms, control spaces and elevator hoistways.

3005.7.2.2 Sprinkler system monitoring. The sprinkler system shall have a sprinkler control valve supervisory switch and water-flow initiating device provided for each floor that is monitored by the building's fire alarm system.

3005.7.3 Water protection. An approved method to prevent water from infiltrating into the hoistway enclosure from the operation of the automatic sprinkler system outside the elevator lobby shall be provided.

3005.7.4 Shunt trip. Means for elevator shutdown in accordance with Section 3005.5 shall not be installed.

(Reason: Firefighter and public safety. This amendment eliminates the shunt trip requirement of the International Building Code Section 3005.5 for the purpose of elevator passenger and firefighter safety. The new section above is intended to be identical to Sections 3007.2, 3007.3, and 3007.4 for Fire Service Access Elevators and Sections 3008.2, 3008.3 and 3008.4 for Occupant Evacuation Elevators.)

*****Section 3005.8; add Section 3005.8 as follows:**

3005.8 Storage. Storage shall not be allowed within the elevator machine room, control room, machinery spaces and or control spaces. Provide approved signage at each entry to the above listed locations stating: "No Storage Allowed."

(Reason: Reinforces the need to maintain space clean and free of combustibles. See companion change to eliminate fire sprinklers therein, to always require an enclosure - with IBC 3005.4 exceptions deleted - resulting in the limited need for a shunt trip system.)

*****Section 3006.2, Hoistway opening protection required; Revise text as follows:**

5. The building is a high rise and the elevator hoistway is more than ~~75 feet (22,860 mm)~~ 55 feet (16,764 mm) in height. The height of the hoistway shall be measured from the lowest floor at or above grade to the highest floors served by the hoistway."

(Reason: 2018 IBC text does not address hoistways that are greater than 75'-0" in height that are both below grade and above grade but not located above the high rise classification nor does the IBC address hoistways wholly located above grade such as those that serve sky lobbies".)

****Section 3202.2.4; Add Section; change to read as follows:**

3202.2.4 Landscaping terraces. Landscaping terraces may be constructed on public property when approved by the Building Official and the Director of Planning provided that:

1. The terrace does not encroach upon or impede passage along a public sidewalk;
2. The terrace is not installed so as to violate any traffic ordinance;

3. The terrace does not exceed the maximum allowed fence height; and
4. When the need arises for the repair or improvement of streets or utilities, the expense for moving the terrace shall be borne by the property owner.

(Reason: To provide an alternative method of streetscape where approved)

****Section 3301.3; Add section; change to read as follows:**

3301.3 Site maintenance. Each person engaged in the construction, alteration or repair of any building shall be responsible for placing all trash and debris in a container or enclosure until the trash and debris are removed from the construction lot or site, and for installing erosion control measures both as required in accordance with the City's NPDES plan. The Building Official may cause all inspections to be withheld or work stopped until:

1. The construction lot or site and adjacent properties are free of trash, debris, or unused material generated from the construction site; and
2. Until effective erosion control measures are installed.

(Reason: To provide requirement for maintenance of work sites)

****Section 3307.2; Add section; change to read as follows:**

3307.2 Damage to public utilities. Any damage to public utilities caused by or during construction shall be immediately replaced or repaired by the owner of the property under construction, or the contractor responsible for the damage, at the expense of the owner or responsible contractor.

(Reason: To ensure damage to any public utility is properly repaired)

****Appendix C: Group U – Agricultural Buildings; adopt with added sections; change to read as follows:**

C101.1 Scope. The provisions of this appendix shall apply exclusively to agricultural buildings. Such buildings shall be classified as Group U and shall include the following uses:

1. Livestock shelters or buildings, including shade structures and milking barns.
2. Poultry buildings or shelters.
3. Barns.
4. Storage of equipment and machinery used exclusively in agriculture.
5. Horticultural structures, including detached production greenhouses and crop protection shelters.
6. Sheds.
7. Grain silos.
8. Stables.
9. Kennels.

(Reason: provides consistent standards with other requirements in the Municipal Code)

****Section C105 – Special Requirements for Kennels:**

Section C105.1 Kennels. Kennels shall comply with the following:

1. Floors shall have a smooth, hard, nonabsorbent, corrosion-resistant surface such as concrete, ceramic tile or other approved materials. Cages with grated floors may be installed above kennel floors. Such grated floors shall be of nonabsorbent; corrosion-resistant materials, sufficient in strength and composition to safely support the animals, protect their feet and legs from injury, and not allow the accumulation of liquids.
2. Floors shall be provided with positive drainage to an approved drainage system. Drainage from a stall or cage shall not flow across or through another stall or cage. Kennel floors shall slope uniformly at a rate of not less than one-fourth (1/4) inch per foot or more than one-half (1/2) inch

per foot to a gutter or floor drain. If provided, gutters shall similarly slope to a drain and have rounded corners to facilitate cleaning. Drains complete with traps and vents shall be installed in accordance with the Plumbing Code and shall be connected to the City's sanitary sewer system or to a septic system approved by the Environmental Health Department.

3. The interior surface of kennel walls to a height of six (6) feet above the floor shall be of materials which are smooth, hard, nonabsorbent and non-corrosive. All joints and seams in interior wall surfaces and between the walls and floors shall be sealed to prevent moisture penetration and to prevent the accumulation of solids and liquids.
4. Kennels shall be provided with ventilation during such time as the building is occupied by animals by means of operable exterior openings with an area of not less than one-twentieth (1/20) of the floor area, or shall be provided with a mechanically operated exhaust system capable of providing at least four (4) air changes per hour. Such systems shall be connected directly to the exterior. Outdoor kennels shall provide adequate shelter from sun, rain and cold weather.

(Reason: To provide for the operation of commercial animal kennels)

End

DRAFT

Exhibit B

Recommended Amendments to the 2018 International Residential Code City of Amarillo, Texas

The following sections, paragraphs, and sentences of the 2018 International Residential Code are hereby amended as follows: Standard type is text from the IRC. Underlined type is text inserted. ~~Lined through type is deleted text from IRC.~~ A double asterisk at the beginning of a section identifies an amendment carried over from the 2015 edition of the code and a triple asterisk identifies a new or revised amendment with the 2018 code.

****Section R101.1; change to read as follows:**

R101.1 Title. These provisions shall be known as the Residential Code for One- and Two- Family Dwellings of the City of Amarillo and shall be cited as such and will be referred to hereinafter as "this code."

(Reason: Standard insertion point: [insert] to assist with local adoption.)

*****Section R102.4; change to read as follows:**

R102.4 Referenced codes and standards. The codes, when specifically adopted, and standards referenced in this code shall be considered part of the requirements of this code to the prescribed extent of each such reference and as further regulated in Sections R102.4.1 and R102.4.2. Whenever amendments have been adopted to the referenced codes and standards, each reference to said code and standard shall be considered to reference the amendments as well. Any reference made to NFPA 70 or the Electrical Code shall mean the Electrical Code as adopted.

(Reason: Legal wording to recognize locally adopted codes and amendments adopted with referenced codes.)

*****Section R103 and R103.1 amend to insert the Department Name**

DEPARTMENT OF BUILDING SAFETY

R103.1 Creation of enforcement agency. The City of Amarillo Department of Building Safety is hereby created and the official in charge thereof shall be known as the Building Official.

(Reason: Reminder to be sure ordinance reads the same as designated by the city.)

*****Section R104.10.1 Flood Hazard areas; delete this section.**

(Reason: Flood hazard ordinances may be administered by other departments within the city.)

****Section R105 amend R501.1 to read as follows:**

R105.1 Required. Any owner or owner's authorized agent who intends to construct, enlarge, alter, repair, move, demolish or change the occupancy of a building or structure, or to erect, install, enlarge, alter, repair, remove, convert or replace any electrical, gas, mechanical or plumbing system, the installation of which is regulated by this code, or to cause any such work to be performed, shall first make application to the Building Official and obtain the required permit prior to the start of demolition or construction activity.

(Reason: Amarillo Municipal Code has specific allowances for homeowners to obtain permit and inspections on their own home.)

****105.2; change to read as follows:**

R105.2 Work exempt from permit. Permits shall not be required for the following. Exemption from permit requirements of this code shall not be deemed to grant authorization for any work to be done in any manner in violation of the provisions of this code or any other laws or ordinances of this jurisdiction.

Building:

1. One-story detached accessory structures provided the floor area does not exceed 200 square feet (18.58 m²).
2. Fences not over 7 8 feet (2,438 mm) high.
3. Retaining walls that are not over 4 feet (1,219 mm) in height measured from the bottom of the footing to the top of the wall, unless supporting a surcharge.
4. Water tanks supported directly upon grade if the capacity does not exceed 5,000 gallons (18,927L) and the ratio of height to diameter or width does not exceed 2 to 1.
5. ~~Sidewalks and~~ Driveways.
6. Painting, papering, tiling, carpeting, cabinets, counter tops and similar finish work.
7. Prefabricated swimming pools that are less than 24 inches (610 mm) deep.
8. Swings and other playground equipment.
9. Window awnings supported by an exterior wall which do not project more than 54 inches (1372 mm) from the exterior wall and do not require additional support.
10. Decks not exceeding 200 square feet (18.58 m²) in area, that are not more than 30 inches (762 mm) above *grade* at any point, are not attached to a *dwelling* and do not serve the exit door required by Section R311.4.

(Reason: Local practices have allowed the use of 8' fencing without incident.)

*****Section R105.3.1.1& R106.1.4; delete these sections.**

(Reason: Floodplain provisions are addressed locally.)

*****Section R108.3; Delete entire section:**

R108.3 Building permit valuations.

(Reason: Requirements consistent with State law. In 2020, the State Legislature enacted HB 852 prohibiting cities from considering values, costs or improvements to determine permit or inspection fees for residential buildings.)

*****Section R110 (R110.1 through R110.5); delete the section.**

(Reason: A building final report can serve as a C of O without providing all information required per these sections.)

*****Section R112; Delete this section and subsection in their entirety.**

R112 Board of Appeals

(Reason: Established Construction Advisory and Appeals Board procedures. See Chapter 2-6 of the Amarillo Municipal Code)

*****Section R202; change definition of "Townhouse" to read as follows:**

TOWNHOUSE. A single-family dwelling unit constructed in a group of three or more attached units separated by property lines in which each unit extends from foundation to roof and with a yard or public way on at least two sides.

(Reason: To distinguish Townhouses on separate lots.)

****Table R301.2 (1); fill in as follows:**

| Ground Snow Load (o) | Wind Design | | | | Seismic Design Category (f) | Subject To Damage From | | | Winter Design Temp (e) | Ice Barrier Underlayment Required (h) | Flood Hazards (g) | Air Freezing Index (i) | Mean Annual Temp (j) |
|----------------------|-------------|-------------------------|-------------------------|---------------------------|-----------------------------|------------------------|----------------------|-------------------|------------------------|---------------------------------------|-------------------|------------------------|----------------------|
| | Speed (d) | Topographic effects (k) | Special wind region (l) | Windborne debris zone (m) | | Weathering (a) | Frost line depth (b) | Termite (c) | | | | | |
| 20 psf | 115 mph | NO | NO | NO | B | Moderate | 18" | Moderate to Heavy | 20° | NO | AMC 4-8 | 311 | 57.2° |

Delete remainder of table "Manual J Design Criteria" and footnote N

(Reason: Manual J is utilized by third party; therefore, this is a reference table only and not needed.)

****Section R302.1; add exception #6 & #7 to read as follows:**

Exceptions: {Exceptions 1 – 5 unchanged}

6. Open non-combustible carport structures may be constructed when also approved within adopted ordinances.
7. Zero lot line structures platted in accordance with the City of Amarillo Zoning Ordinance. The following specific provisions shall apply:
 - 7.1 Exterior wall finish shall be brick veneer, masonry units or other approved materials.
 - 7.2 Soffit material shall be of approved material.
 - 7.3 Roof ventilation openings not permitted underside of soffit.
 - 7.4 Plumbing cleanouts allowed when required.
 - 7.5 Allowance of openings constructed of masonry unit glass: single opening maximum 9 square feet or up to three (3) openings; each a maximum of 4 square feet, spaced minimum 24 inches apart.

(Reason: Refers to other ordinances, such as zoning ordinances.)

*****Section R302.3; add Exception #3 to read as follows:**

Exceptions:

1. *{Existing text unchanged}*
2. *{Existing text unchanged}*
3. Two-family dwelling units that are also divided by a property line through the structure shall be separated as required for townhouses.

(Reason: Provide guidance for a common construction method in this area. Correlates with amendment to IRC Section R202 Townhouse definition.)

*****Section R302.5.1; change to read as follows:**

R302.5.1 Opening protection. Openings from a private garage directly into a room used for sleeping purposes shall not be permitted. Other openings between the garage and residence shall be equipped with solid wood doors not less than 13/8 inches (35 mm) in thickness, solid or honeycomb core steel doors not less than 13/8 inches (35 mm) thick, or 20-minute fire-rated doors. ~~Equipped with a self-closing or automatic-closing device.~~

(Reason: Absence of data linking self-closing devices to increased safety. Self-closing devices often fail to close the door entirely.)

*****Section R303.3, Exception; amend to read as follows:**

Exception: *{Existing text unchanged}* Spaces containing only a water closet or water closet and a lavatory may be ventilated with an approved mechanical recirculating fan or similar device designed to remove odors from the air.

(Reason: Consistent with common local practice as recirculating fans are recognized as acceptable air movement.)

****Section R313; Automatic Fire Sprinkler Systems; Delete this section and subsection in their entirety.**

(Reason: In 2009, the State Legislature enacted SB 1410, amending section 1301.551 subsection I of the occupation code, prohibiting cities from enacting fire sprinkler mandates for one- or two-family dwellings only. However, jurisdictions with ordinances that required sprinklers for one- or two-family dwellings prior to and enforced before January 1, 2009, may remain in place.)

****Section R315.2.2 Alterations, repairs and additions; amend to read as follows:**

Exception:

1. Work involving the exterior surfaces of *dwellings*, such as the ~~replacement of roofing or siding, the addition or replacement of windows or doors, or the addition of a porch or deck,~~ are exempt from the requirements of this section.
2. Installation, alteration or repairs of plumbing ~~or mechanical systems~~ when all such work occurs on the exterior of dwellings, such as water or sewer lines, or lawn irrigation systems are exempt from the requirements of this section.

(Reason: The 2013 Hailstorm and resulting roofing inspections demonstrated the importance of requiring carbon monoxide alarm installation. As roofing operations occurred it was common for fuel-fired appliance vents to become disconnected or plugged creating hazards for occupants. Approximately 50% of those inspections resulted in fuel-fired venting failures. Furthermore, in order to provide early detection of carbon monoxide in dwellings, any work occurring inside, or affects the interior environment of the dwelling requires carbon monoxide alarm installation.)

****Section 315.3; change to read as follows:**

R315.3 Location. Carbon monoxide alarms in dwelling units shall be installed outside of each separate sleeping area in the immediate vicinity of the bedrooms. Where a fuel-burning appliance is located within a bedroom or its attached bathroom, a carbon monoxide alarm shall be installed within the bedroom. Approved alarms shall be installed in accordance with manufacturers' installation instructions or located on the wall or ceiling at a height 42 inches above floor, avoiding locations near heating/cooling vents or areas which provide turbulent airflow, and minimum 36 inches away from openings to areas of high humidity. Avoid installing CO alarms in kitchens or above fuel- burning appliances.

(Reason: To clarify installation requirements for consistent application.)

****Section 319; change to read as follows:**

R319.1 Address identification. Buildings shall be provided with approved address identification. The address identification shall be legible and placed in a position that is visible from the street or road fronting the property. Address identification characters shall contrast with their background. Address numbers shall be Arabic numbers or alphabetical letters. Numbers shall be spelled out. Each character shall be not less than 4 inches (102mm) in height with a stroke width of not less than 0.5 inch (12.7mm). Where required by the ~~fire~~ code official, address identification shall be provided in additional approved locations facilitate emergency response. Where access is by means of a private road and the building address cannot be viewed from the public way, a monument, pole or other sign or means shall be used to identify the structure. Address identification shall be maintained.

(Reason: Any code official is responsible for review and enforcement of IRC provisions. This modification clarifies responsibility and to promote consistent application)

*****Section R322 Flood Resistant Construction; deleted section.**

(Reason: Floodplain hazard ordinances may be administered by other departments within the city.)

****Section R401.2; amended existing paragraph to read as follows.**

Section R401.2. Requirements. *{Existing text unchanged}*. Gravel fill used as footings for wood and precast concrete foundations shall comply with Section R403. Concrete foundations will be designed by registered design professional licensed in the State of Texas or constructed in compliance with the 2015 Panhandle Residential Foundation Manual.

(Reason: To reduce the cost of residential construction significant development work was performed by the Construction Advisory and Appeals Board foundation subcommittee. The subcommittee established design standards for regional use.)

****405.1; amend; Exception: (add to the end of paragraph) to read as follows:**

Exception: A drainage system is not required when the foundation is installed on well-drained ground or sand-gravel mixture soils according to the Unified Soil Classification System, Group I Soils, as detailed in Table R405.1- or constructed in accordance with the 2015 Panhandle Residential Foundation Manual.


(Reason: The region experiences problems with expansive soils, in an effort to reduce the cost of residential construction significant development work was performed by the Construction Advisory and Appeals Board foundation subcommittee. The subcommittee established design standards for regional use.)

*****Section R602.6.1; amend the following:**

R602.6.1 Drilling and notching of top plate. When piping or ductwork is placed in or partly in an exterior wall or interior load-bearing wall, necessitating cutting, drilling or notching of the top plate by more than 50 percent of its width, a galvanized metal tie not less than 0.054 inch thick (1.37 mm) (16 Ga) and 4 ½ inches (38 mm) 5 inches (127 mm) wide shall be fastened across and to the plate at each side of the opening with not less than eight 10d (0.148 inch diameter) having a minimum length of 1 ½ inches (38 mm) at each side or equivalent. Fasteners will be offset to prevent splitting of the top plate material. The metal tie must extend a minimum of 6 inches past the opening. See figure R602.6.1. *{Remainder unchanged}*

(Reason: To clarify proper method to utilize when notching of top plate occurs.)

*****Figure R602.6.1; delete the figure and insert the following figure:**

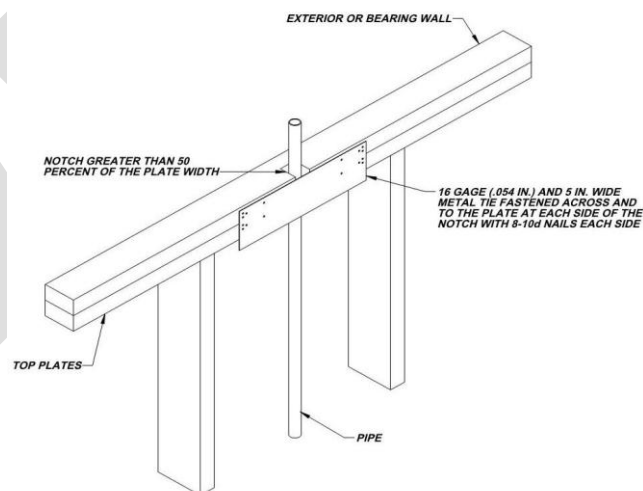

(Reason: Amendment to provide additional assurance of maintaining the integrity of the framing by spreading the nailing pattern.)

*****Add section R703.8.4.1.2 Veneer Ties for Wall Studs; to read as follows:**

R703.8.4.1.2 Veneer Ties for Wall Studs. In stud framed exterior walls, all ties may be anchored to studs as follows:

1. When studs are 16 in (407 mm) o.c., stud ties shall be spaced no further apart than 24 in (737 mm) vertically starting approximately 12 in (381 mm) from the foundation; or
2. When studs are 24 in (610 mm) o.c., stud ties shall be spaced no further apart than 16 in (483 mm) vertically starting approximately 8 in (254 mm) from the foundation.

(Reason: This amendment had been a carryover amendment for years to provide clear instruction for placement of brick ties. It is now retained with changes to reflect its correct placement and use for clarity when attachment to framing lumber (studs). It should remain for those purposes. It is in addition to the new Table in 2018 which provides for brick ties directly to sheathing.)

****Section R902.1; amend and add exception #5 to read as follows:**

R902.1 Roofing covering materials. Roofs shall be covered with materials as set forth in Sections R904 and R905. Class A, B, or C roofing shall be installed ~~in designated by law as requiring their use or when the edge of the roof is less than 3 feet from a lot line.~~ {Remainder unchanged}

Exceptions:

1. {Existing text unchanged}
2. {Existing text unchanged}
3. {Existing text unchanged}
4. {Existing text unchanged}
5. Non-classified roof coverings shall be permitted on one-story detached accessory structures used as tool and storage sheds, playhouses and similar uses, provided the floor area does not exceed (area defined by jurisdiction).

(Reason: to address accessory structures Group U exempt from permits per Section R105.2)

****905.7.1 change to read as follows:**

R905.7.1 Deck requirements. Wood shingles shall be used only on solid ~~or spaced~~ sheathing. ~~Where spaced sheathing is used, sheathing boards shall not be less than 1-inch by 4-inch (25mm by 102 mm) nominal dimensions and shall be spaced on centers equal to the weather exposure to coincide with the placement of fasteners.~~

(Reason: Due to the wind and blowing snow in the Panhandle, there is greater potential for wind driven snow blows between the shingles and into the attic area.)

****905.8.1 change to read as follows:**

R905.8.1 Deck requirements. Wood shakes shall be used only on solid ~~or spaced~~ sheathing. ~~Where spaced sheathing is used, sheathing boards shall not be less than 1-inch by 4-inch (25mm by 102 mm) nominal dimensions and shall be spaced on centers equal to the weather exposure to coincide with the placement of fasteners. Where 1-inch by 4-inch (25 mm by 102 mm) spaced sheathing is installed at 10 inches (254 mm) on center, additional 1-inch by 4-inch (25 mm by 102 mm) boards shall be installed between the sheathing boards.~~

(Reason: Due to the wind and blowing snow in the Panhandle, there is greater potential for wind driven snow blows between the shingles and into the attic area.)

****905.8.5; Insert; Table R905.8.5 amended as follows:**

TABLE R905.8.5 WOOD SHAKE MATERIAL REQUIREMENTS

| MATERIAL | MINIMUM GRADES | APPLICABLE GRADING RULES |
|--|-----------------------|---|
| Wood shakes of naturally durable wood | 1 | Cedar Shake and Shingle Bureau |
| Taper sawn shakes and shingles of naturally durable wood | 1 or 2 | Cedar Shake and Shingle Bureau |
| Preservative-treated shakes and shingles of naturally durable wood | 1 | Cedar Shake and Shingle Bureau |
| Fire-retardant-treated shakes of naturally durable wood | 1 | Cedar Shake and Shingle Bureau |
| Preservative-treated taper sawn shakes of Southern pine treated in accordance with AWPA Standard U1 (Commodity Specification A, Use Category 3B and section 5.6) | 1 or 2 | Forest Products Laboratory of the Texas Forest Services |

(Reason: modified for local blowing snow conditions.)

****908.1; clarification; change to read as follows:**


908.1 General. Materials and methods of application used for re-covering or replacing an existing roof covering shall comply with the requirements of Chapter 9, including but not limited to decking, flashing, and ventilation.

(Reason: Due to national insurance companies' failure to interpret re-roofing roofing requirements are the same as new.)

****Section R908.3.1.1; insert Figure 908.3.1.1; change to read as follows:**

R908.3.1.1. A roof re-cover shall not be permitted where any of the following conditions occur:

1. Where the existing roof or roof covering is water-soaked or has deteriorated to the point that the existing roof or roof covering is not adequate as a base for additional roofing.
2. Where the existing roof covering is wood, slate, clay, cement or asbestos-cement tile.
3. Where the existing roof has two or more applications of any type of roof covering.
4. For asphalt shingles, when the building is located in an area subject to moderate or severe hail exposure according to Figure R908.3.1.1.

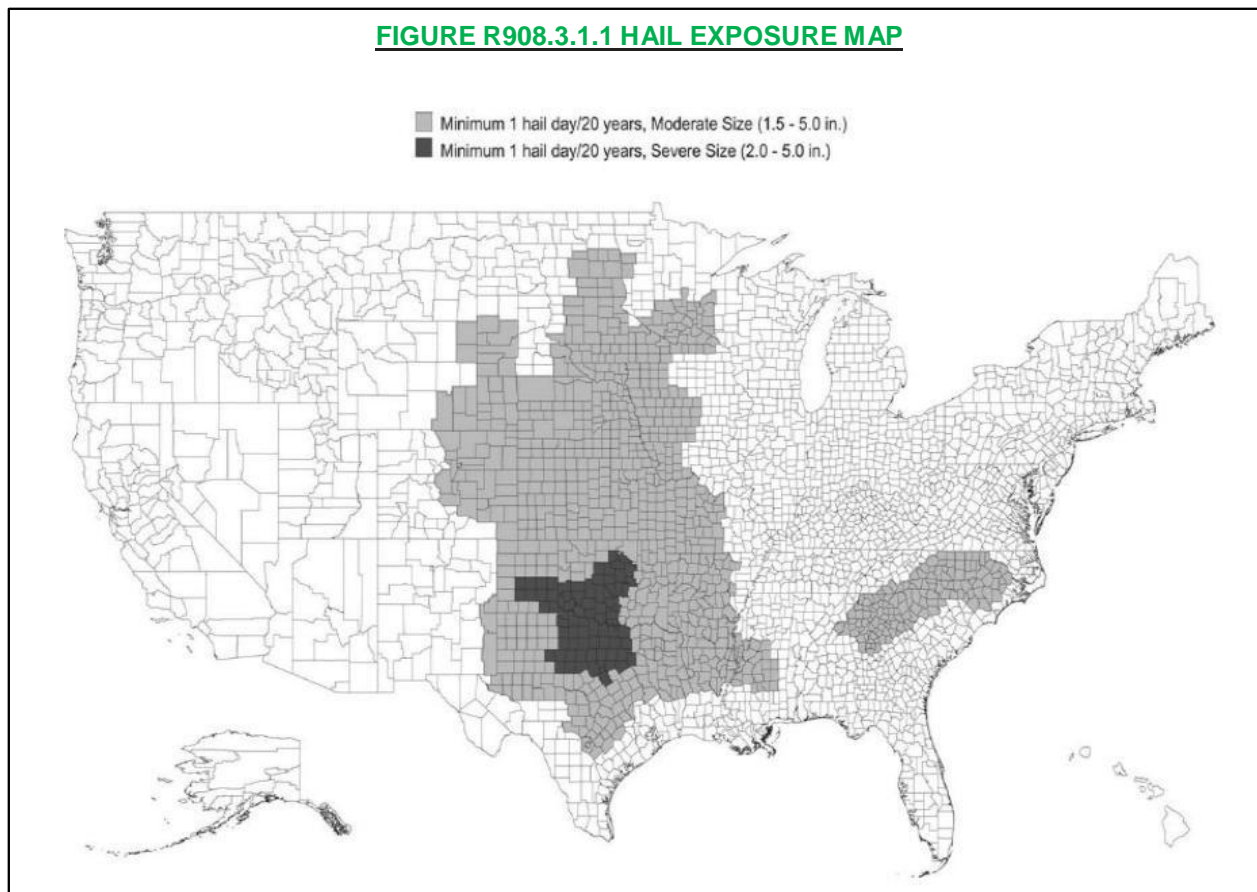

(Reason: Due to the of weather in the Panhandle, wind and hail damage is more prone when asphalt shingles used for re-covering; contractors unable to verify if any of the decking may need to be replaced and unable to verify the flashing integrity; roof framing practices in the Panhandle have typically utilized 2 x 6 framing members, not designed for the additional weight of a second layer of shingles.)

*****Chapter 11 [RE] – Energy Efficiency is deleted in its entirety; Reference the 2018 IECC for energy code provisions and recommended amendments.**

(Reason: The recommended energy code changes from the Energy and Green Advisory Board update the amendments for Chapter 11. The 2018 International Energy Conservation Code should be referenced for residential energy provisions. This approach simply minimizes the number of amendments to the IRC.)

*****Section M1305.1.2; change to read as follows:**

M1305.1.2 Appliances in attics. Attics containing appliances shall be provided . . . *{Bulk of paragraph unchanged}* . . . side of the appliance. The clear access opening dimensions shall be a minimum of 20 inches by 30 inches (508 mm by 762 mm), and large enough to allow removal of the largest appliance. As a minimum, for access to the attic space, provide one of the following:

1. A permanent stair.
2. A pull-down stair with a minimum 300 lb. (136 kg) capacity.
3. An access door from an upper floor level.

Exceptions:

1. The passageway and level service space are not required where the *appliance* can be serviced and removed through the required opening.
2. Where the passageway is unobstructed...*{Remaining text unchanged}*

(Reason: To provide a safe means of accessibility to appliances in attics and to allow for different types of construction limitations. Consistent with regional amendment to IFGC and IMC 306.3.)

****M1402.4; add the following to read as follows:**

1402.4 Total electric heating. Primary central heating and cooling forced air systems utilizing only electric heat shall utilize heat pumps.

(Reason: Total electric heating without the use of heat pumps does not provide energy efficiency and results in excessive energy bill. It is not in the best interest of property owners or homeowners.)

*****Section M1411.3; change to read as follows:**

M1411.3 Condensate disposal. Condensate from all cooling coils or evaporators shall be conveyed from the drain pan outlet to ~~an approved place of disposal~~ a sanitary sewer through a trap, by means of a direct or indirect drain. *{Remaining text unchanged}*

(Reason: Reflects regional practice and to reduce excessive runoff into storm drains.)

****Section M1411.3.1, Items 3 and 4; add text to read as follows:**

M1411.3.1 Auxiliary and secondary drain systems. *{Bulk of paragraph unchanged}*

1. *{Existing text unchanged}*
2. *{Existing text unchanged}*
3. An auxiliary drain pan... *{bulk of text unchanged}*... with Item 1 of this section. A water level detection device may be installed only with prior approval of the Building Official.
4. A water level detection device... *{bulk of text unchanged}*... overflow rim of such pan. A water level detection device may be installed only with prior approval of the Building Official.

(Reason: Reflects standard practice in this area.)

*****Section M1411.3.1.1; add text to read as follows:**

M1411.3.1.1 Water-level monitoring devices. On down-flow units ...*{bulk of text unchanged}*... installed in the drain line. A water level detection device may be installed only with prior approval of the Building Official.

(Reason: Reflects standard practice in this area.)

****M1411.4; change to read as follows:**

1411.4 Condensate Pumps. Condensate pumps located in uninhabitable space, such as attics and crawl spaces, shall be connected to the appliance or equipment served such that when the pump fails, the appliance or equipment will be prevented from operating. Pumps shall be installed in accordance with the manufacturer's instructions and shall not prevent the operation of fuel fired appliances.

(Reason: Heating units in the Panhandle are typically installed in unconditioned areas, shutting the heating equipment down may result in frozen plumbing if home is unoccupied for an extended period of time resulting in damage to interior finishes.)

*****M1503.6 Makeup Air Required; amend and add exception as follows:**

M1503.6 Makeup air required. Where one or more gas, liquid or solid fuel-burning appliance that is neither direct-vent nor uses a mechanical draft venting system is located within a dwelling unit's air barrier, each exhaust system capable of exhausting in excess of 400 cubic feet per minute (0.19 m³/s) shall be mechanically or passively provided with makeup air at a rate approximately equal to the difference between exhaust air rate and 400 cubic feet per minute. Such makeup air systems shall be equipped with not fewer than one damper complying with Section M1503.6.2.

Exception: Makeup air is not required for exhaust systems installed for the exclusive purpose of space cooling and intended to be operated only when windows or other air inlets are open. Where all appliances in the house are of sealed combustion, power-vent, unvented, or electric, the exhaust hood system shall be permitted to exhaust up to 600 cubic feet per minute (0.28 m³/s) without providing makeup air. Exhaust hood systems capable of exhausting in excess of 600 cubic feet per minute (0.28 m³/s) shall be provided with a makeup air at a rate approximately to the difference between the exhaust air rate and 600 cubic feet per minute.

(Reason: Exception requires makeup air equaling the amount above and beyond 400 cfm for larger fan which will address concerns related to "fresh" air from the outdoors in hot humid climates creating a burden on HVAC equipment and negative efficiency impacts from back-drafting and wasted energy.)

*****Section M2005.2; change to read as follows:**

M2005.2 Prohibited locations. Fuel-fired water heaters shall not be installed in a room used as a storage closet. Water heaters located in a bedroom or bathroom shall be installed in a sealed enclosure so that combustion air will not be taken from the living space. Access to such enclosure may be from the bedroom or bathroom when through a solid door, weather-stripped in accordance with the exterior door air leakage requirements of the International Energy Conservation Code and equipped with an approved self-closing device. Installation of direct-vent water heaters within an enclosure is not required.

(Reason: Corresponds with the provisions of IFGC Section 303.3, exception #5.)

*****Section G2408.3 (305.5) Private Garages; delete this section in its entirety.**

(Reason: This provision does not reflect standard practice in this area.)

*****Section G2415.2.1 (404.2.1) CSST; add a second paragraph to read as follows:**

Both ends of each section of medium pressure gas piping shall identify its operating gas pressure with an approved tag. The tags are to be composed of aluminum or stainless steel and the following wording shall be stamped into the tag:

"WARNING: 1/2 to 5 psi gas pressure - Do Not Remove"

(Reason: To protect homeowners and plumbers.)

*****Section G2415.12 (404.12) and G2415.12.1 (404.12.1); change to read as follows:**

G2415.12 (404.12) Minimum burial depth. Underground piping systems shall be installed a minimum depth of 12 inches (305 mm) 18 inches (457 mm) below grade, ~~except as provided for in Section G2415.12.1.~~

G2415.12.1 (404.12.1) Individual Outdoor Appliances; {Delete in its entirety}

(Reason: To provide increased protection to piping systems.)

*****Section G2417.1 (406.1); change to read as follows:**

G2417.1 (406.1) General. Prior to acceptance and initial operation, all piping installations shall be inspected and pressure tested to determine that the materials, design, fabrication, and installation practices comply with the requirements of this code. The permit holder shall make the applicable tests prescribed in Sections 2417.1.1 through 2417.1.5 to determine compliance with the provisions of this code. The permit holder shall give reasonable advance notice to the building official when the piping system is ready for testing. The equipment, material, power and labor necessary for the inspections and test shall be furnished by the permit holder and the permit holder shall be responsible for determining that the work will withstand the test pressure prescribed in the following tests.

(Reason: To utilize language used in the IPC regarding who is responsible for testing procedures.)

*****Section G2417.4; change to read as follows:**

G2417.4 (406.4) Test pressure measurement. Test pressure shall be measured with a monometer or with a pressure-measuring device designed and calibrated to read, record, or indicate a pressure loss caused by leakage during the pressure test period. The source of pressure shall be isolated before the pressure tests are made. ~~Mechanical gauges used to measure test pressures shall have a range such that the highest end of the scale is not greater than five times the test pressure.~~

(Reason: To require the use of more accurate diaphragm gauges. Spring gauges do not provide accurate measurement below approximately 17 psig.)

*****Section G2417.4.1; change to read as follows:**

G2417.4.1 (406.4.1) Test pressure. The test pressure to be used shall be no less than 3 psig (20 kPa gauge), or at the discretion of the Code Official, the piping and valves may be tested at a pressure of at least six (6) inches (152 mm) of mercury, measured with a manometer or slope gauge, irrespective of design pressure. Where the test pressure exceeds 125 psig (862 kPa gauge), the test pressure shall not exceed a value that produces a hoop stress in the piping greater than 50 percent of the specified minimum yield strength of the pipe. For tests requiring a pressure of 3 psig, diaphragm gauges shall utilize a dial with a minimum diameter of three and one half inches (3 1/2"), a set hand, 1/10 pound incrementation and pressure range not to exceed 6 psi for tests requiring a pressure of 3 psig. For tests requiring a pressure of 10 psig, diaphragm gauges shall utilize a dial with a minimum diameter of three and one-half inches (3 1/2"), a set hand, a minimum of 2/10 pound incrementation and a pressure range not to exceed 20 psi. For welded piping, and for piping carrying gas at pressures in excess of fourteen (14) inches water column pressure (3.48 kPa) (1/2 psi) and less than 200 inches of water column pressure (52.2 kPa) (7.5 psi), the test pressure shall not be less than ten (10) pounds per square inch (69.6 kPa). For piping carrying gas at a pressure that exceeds 200 inches of water column (52.2 kPa) (7.5 psi), the test pressure shall be not less than one and one-half times the proposed maximum working pressure.

Diaphragm gauges used for testing must display a current calibration and be in good working condition. The appropriate test must be applied to the diaphragm gauge used for testing

(Reason: To provide for lesser pressures to coordinate with the use of more accurate diaphragm gauges.)

*****Section G2417.4.2; change to read as follows:**

G2417.4.2 (406.4.2) Test duration. The test duration shall be held for a length of time satisfactory to the Building Official, but in no case for ~~be not~~ less than ~~40-fifteen~~ (15) minutes. For welded piping, and for piping carrying gas at pressures in excess of fourteen (14) inches water column pressure (3.48 kPa), the test duration shall be held for a length of time satisfactory to the Building Official, but in no case for less than thirty (30) minutes.

(Reason: To comply with accepted regional practices.)

*****Section G2420.1 (406.1); add Section G2420.1.4 to read as follows:**

G2420.1.4 Valves in CSST installations. Shutoff valves installed with corrugated stainless steel (CSST) piping systems shall be supported with an approved termination fitting, or equivalent support, suitable for the size of the valves, of adequate strength and quality, and located at intervals so as to prevent or damp out excessive vibration but in no case greater than 12-inches from the center of the valve. Supports shall be installed so as not to interfere with the free expansion and contraction of the system's piping, fittings, and valves between anchors. All valves and supports shall be designed and installed so they will not be disengaged by movement of the supporting piping.

(Reason: To provide proper security to CSST valves. These standards were established in this region in 1999 when CSST was an emerging technology.)

*****Section G2420.5.1 (409.5.1); add text to read as follows:**

G2420.5.1 (409.5.1) Located within the same room. The shutoff valve...*{Bulk of paragraph unchanged}*... in accordance with the appliance manufacturer's instructions. A secondary shutoff valve must be installed within 3 feet (914 mm) of the firebox if appliance shutoff is located in the firebox.

(Reason: Reflects regional practice and provides an additional measure of safety.)

*****Section G2421.1 (410.1); add text and Exception to read as follows:**

G2421.1 (410.1) Pressure regulators. A line pressure regulator shall be...*{bulk of paragraph unchanged}*...approved for outdoor installation. Access to regulators shall comply with the requirements for access to appliances as specified in Section M1305.

Exception: A passageway or level service space is not required when the regulator is capable of being serviced and removed through the required attic opening.

(Reason: To require adequate access to regulators.)

*****Section G2422.1.2.3 (411.1.3.3) Prohibited locations and penetrations; delete Exception 1 and Exception 4.**

(Reason: To comply with accepted regional practices.)

*****Section G2445.2 (621.2); add Exception to read as follows:**

G2445.2 (621.2) Prohibited use. One or more unvented room heaters shall not be used as the sole source of comfort heating in a dwelling unit.

Exception: Existing approved unvented room heaters may continue to be used in dwelling units, in accordance with the code provisions in effect when installed, when approved by the Building Official unless an unsafe condition is determined to exist as described in International Fuel Gas Code Section 108.7 of the Fuel Gas Code.

(Reason: Gives code official discretion.)

*****Section G2448.1.1 (624.1.1); change to read as follows:**

G2448.1.1 (624.1.1) Installation requirements. The requirements for water heaters relative to access, sizing, relief valves, drain pans and scald protection shall be in accordance with this code.

(Reason: To clarify installation requirements. Also corresponds with amendments regarding water heater access.)

****Section P2503.6; change to read as follows:**

P2503.6 Shower liner test. Where shower floors and receptors are made watertight by the application of materials required by Section P2709.2, the completed liner installation shall be tested prior to the installation of the shower floor covering. The pipe from the shower drain shall be plugged watertight for the test. The floor and receptor area shall be filled with potable water to a depth of not less than 2 inches (51mm) measured at the threshold. Where a threshold of not less than 2 inches (51mm) in height does not exist, a temporary threshold shall be constructed to retain the test water in the lined floor or receptor area to a level not less than 2 inches (51mm) in depth measured at the threshold. The water shall be retained for a test period of not less than 15 minutes and there shall not be evidence of leakage.

(Reason: Recognizing local construction practices and the need for ensure under floor plumbing systems installed watertight.)

*****Section P2603; add to read as follows:**

P2603.3 Protection against corrosion. Metallic piping, except for cast iron, ductile iron and galvanized steel, shall not be placed in direct contact with steel framing members, concrete or cinder walls and floors or other masonry. Metallic piping shall not be placed in direct contact with corrosive soil. Where sheathing is used to prevent direct contact, the sheathing shall have a thickness of not less than 0.008 inch (8 mil) (0.203 mm) and the sheathing shall be made of approved material plastic. Where sheathing protects piping that penetrates concrete or masonry walls or floors, the sheathing shall be installed in a manner that allows movement of the piping within the sheathing.

(Reason: Allows for other materials to be accepted.)

****Section P2603.5.1 Sewer Depth; change to read as follows:**

P2603.5.1 Sewer depth. Building sewers that connect to private sewage disposal systems shall be a minimum of 12 inches (304mm) below finished grade at the point of septic tank connection. Building sewers shall be a minimum of 12 inches (304 mm) below grade.

(Reason: Provides sewer depth that is common in this region. Deleted reference to private sewage disposal because a private sewage disposal code is not typically adopted in this region.)

*****Section P2604; add to read as follows:**

P2604.2.1 Plastic sewer and DWV piping installation. Plastic sewer and DWV piping installed underground shall be installed in accordance with the manufacturer's installation instructions. Trench width shall be controlled to not exceed the outside the pipe diameter plus 16 inches or in a trench which has a controlled width equal to the nominal diameter of the piping multiplied by 1.25 plus 12 inches. The piping shall be bedded in 4 inches of granular fill and then backfilled compacting the side fill in 6-inch layers on each side of the piping. The compaction shall be to minimum of 85 percent standard proctor density and extend to a minimum of 6 inches above the top of the pipe.

(Reason: To follow manufacturer backfill requirements and to be clear to Inspectors out in the field.)

*****Section P2801; change to read as follows:**

P2801.6 Required pan. Where a storage tank-type water heater or a hot water storage tank is installed in a location where water leakage from the tank will cause damage, the tank shall be installed in a pan constructed of one of the following:

1. Galvanized steel or aluminum of not less than 0.0236 inch (0.6010 mm) in thickness.
2. Plastic not less than 0.036 inch (0.9 mm) in thickness.
3. Other approved materials.

~~A plastic pan beneath a gas-fired water heater shall be constructed of material having a flame spread index of 25 or less and a smoke-developed index of 450 or less when tested in accordance with ASTM E84 or UL 723.~~

(Reason: Plastic burns degrading material over time on gas fired water heaters and to maintaining protection level.)

*****Section P2801.6.1; change to read as follows:**

Section P2801.6.1 Pan size and drain. The pan shall be not less than 11/2 inches (38 mm) in depth and shall be of sufficient size and shape to receive all dripping or condensate from the tank or water heater. The pan shall be drained by an indirect waste pipe having a diameter of not less than 3/4 inch (19 mm). Piping for safety pan drains shall be of those materials listed in Table P2906.5.

Multiple pan drains may terminate to a single discharge piping system when approved by the administrative authority and permitted by the manufactures installation instructions and installed with those instructions. {Existing text unchanged}

(Reason: Regionally accepted practice.)

*****Section P2804.6.1; change to read as follows:**

Section P2804.6.1 Requirements for discharge piping. The discharge piping serving a pressure relief valve, temperature relief valve or combination thereof shall:

1. Not be directly connected to the drainage system.
2. Discharge through an air gap ~~located in the same room as the water heater.~~
3. Not be smaller than the diameter of the outlet of the valve served and shall discharge full size to the air gap.
4. Serve a single relief device and shall not connect to piping serving any other relief device or equipment.

Exception: Multiple relief devices may be installed to a single T & P discharge piping system when approved by the administrative authority and permitted by the manufactures installation instructions and installed with those instructions.

5. Discharge to the floor, to the pan serving the water heater or storage tank, to a waste receptor an approved location or to the outdoors.

{Remainder unchanged}

Local Amendments:

1. Use of flexible copper on discharge piping serving a pressure-relief valve, temperature-relief valve or combination valve is prohibited.
2. When a water heater is located in the interior of a building/residence with no method to drain the pan according to this code, a water alarm and shut-off device shall be installed.
3. If the discharge piping serving a pressure-relief valve, temperature-relief valve or combination valve is unable to be discharged to the outside according to this code, alternate discharge means or methods may be approved by the Code Official on a case by case basis.

(Reason: To ensure the T&P is ran to the exterior.)

*****Section P2902.5.3; change to read as follows:**

P2902.5.3 Lawn irrigation systems. The potable water supply to lawn irrigation systems shall be protected against backflow by an atmospheric-type vacuum breaker, a pressure-type vacuum breaker, a double-check assembly or a reduced pressure principle backflow preventer. A valve shall not be installed downstream from an atmospheric vacuum breaker. Where chemicals are introduced into the system, the potable water supply shall be protected against backflow by a reduced pressure principle backflow preventer.

(Reason: To provide clarity.)

*****Section P3003.9; change to read as follows:**

P3003.9.2 Solvent cementing. Joint surfaces shall be clean and free from moisture. A purple primer that conforms to ASTM F 656 shall be applied. Solvent cement not purple in color and conforming to ASTM D 2564, CSA B137.3, CSA B181.2 or CSA B182.1 shall be applied to all joint surfaces. The joint shall be made while the cement is wet and shall be in accordance with ASTM D 2855. Solvent cement joints shall be permitted above or below ground.

Exception: A primer is not required where both of the following conditions apply:

- ~~1. The solvent cement used is third party certified as conforming to ASTM D 2564~~
- ~~2. The solvent cement is used only for joining PVC drain, waste, and vent pipe and fittings in not pressure applications in sizes up to and including 4 inches (102mm) in diameter.~~

(Reason: to keep the "process of joining PVC pipe".)

*****Section P3111Combination waste and vent systems; delete this section in its entirety.**

(Reason: A combination waste and vent system is not approved for use in residential construction.)

*****Section P3112.2 Vent Collection; delete and replace with the following:**

P3112.2 Installation. Traps for island sinks and similar equipment shall be roughed in above the floor and may be vented by extending the vent as high as possible, but not less than the drainboard height and then returning it downward and connecting it to the horizontal sink drain immediately downstream from the vertical fixture drain. The return vent shall be connected to the horizontal drain through a wye-branch fitting and shall, in addition, be provided with a foot vent taken off the vertical fixture vent by means of a wye-branch immediately below the floor and extending to the nearest partition and then through the roof to the open air or may be connected to other vents at a point not less than six (6) inches (152 mm) above the flood level rim of the fixtures served. Drainage fittings shall be used on all parts of the vent below the floor level and a minimum slope of one-quarter (1/4) inch per foot (20.9 mm/m) back to the drain shall be maintained. The return bend used under the drain-board shall be a one (1) piece fitting or an assembly of a forty-five (45) degree (0.79 radius), a ninety (90) degree (1.6 radius) and a forty-five (45) degree (0.79 radius) elbow in the order named. Pipe sizing shall be as elsewhere required in this Code. The island sink drain, upstream of the return vent, shall serve no other fixtures. An accessible cleanout shall be installed in the vertical portion of the foot vent.

(Reason: To clarify the installation of island venting and to provide a regional guideline on a standard installation method for this region.)

END